


House Plan Zone, LLC.

www.HPZplans.com

Phone: 601.336.3254

Email: sales@hpzplans.com

Fax: 1-800-574-1387

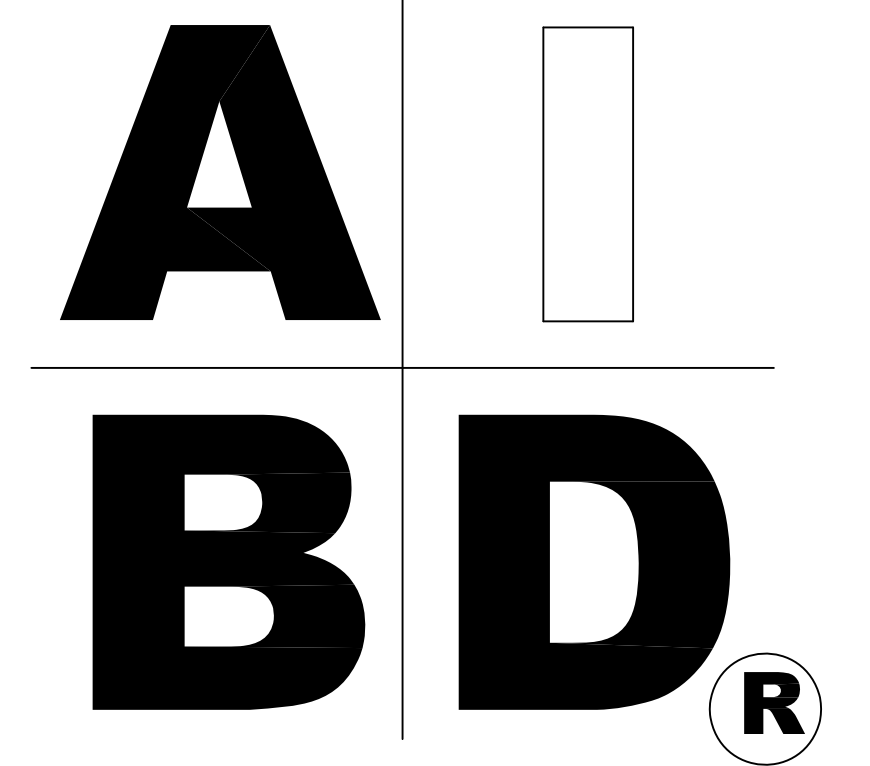

STANDARD ABBREVIATIONS

@	AT	JT.	JOINT
#	FOUND(S)	JST.	JOIST
		JSTS.	JOISTS
APPROX.	APPROXIMATELY		
BASE.	BASEMENT	LT.	LIGHT
B/T	BETWEEN	LIN.	LINEN
BLK.	BLOCK	MANUF.	MANUFACTURER
BLK'G	BLOCKING	MAS.	MASONRY
BD.	BOARD	MAX.	MAXIMUM
BRD.	BOARD	MTL.	METAL
BOT.	BOTTOM	MIN.	MINIMUM
BLDG.	BUILDING	N.I.C.	NOT IN CONTRACT
CAB.	CABINET	O.C.	ON CENTER
CLG.	CEILING	O/C	ON CENTER
CLR.	CLEAR	OPT.	OPTIONAL
CLOS.	CLOSET	O.S.B.	ORIENTED STRAND BOARD
COL.	COLUMN	OTS	OWNER TO SELECT
COLS.	COLUMNS	O.T.S.	OWNER TO SELECT
CONC.	CONCRETE		
CMU	CONCRETE MASONRY UNIT	PG.	PAGE
CU.	CONDENSOR UNIT	FAN.	FANTRY
CONN.	CONNECTION	PL.	PLATE
CONT.	CONTINUOUS	P	PLATE
COVER'G	COVERING	PLYWD	PLYWOOD
CS	CRAWL SPACE	PLYWD	PLYWOOD
		POLY.	POLYETHYLENE
DECO.	DECORATIVE	PSI	POUNDS PER SQUARE INCH
DET.	DETAIL	PRE-FAB	PREFABRICATED
DIA.	DIAMETER		
D/W	DISHWASHER	RE.	REFERENCE
DBL.	DOUBLE	REF.	REFRIGERATOR
DF.	DOUGLAS FIR	REINF.	REINFORCED
D	DRYER	R	RESISTANCE
		R.A.	RETURN AIR
EA.	EACH	R.A.G.	RETURN AIR GRILLE
ELEV.	ELEVATION	REQ'D	REQUIRED
ENG.	ENGINEER		
		SCR.	SCREEN
FT.	FEET	SHLVG.	SHELVES
F.F.L.	FINISHED FLOOR LINE	SHR.	SHOWER
FIN.	FINISH	SHWR.	SHOWER
F.C.	FIRE CODE	SST.	SIMPSON STRONG TIE
FLR.	FLOOR	SP	SOUTHERN PINE
FTG.	FOOTING	SPECS.	SPECIFICATIONS
FOUND.	FOUNDATION	SQ.	SQUARE
FND.	FOUNDATION	S.F.	SQUARE FOOTAGE
FR.	FREEZER	STL.	STEEL
GA.	GAUGE	THK.	THICK
GALV.	GALVANIZED	THK.	THICKNESS
GYP.	GYPSONUM	TBD.	TO BE DETERMINED
		TR.	TRANSOM
HDR.	HEADER	TYP.	TYPICAL
HVAC	HEATING, VENTILATION & AIR CONDITIONING		
HT.	HEIGHT	U.T.C.	UNDER THE COUNTER
HTS.	HEIGHTS	UTIL.	UTILITY
HORIZ.	HORIZONTAL		
		VAN.	VANITY
IN.	INCHES	VERT.	VERTICAL
INCL.	INCLUDE		
INSUL.	INSULATION	WH	WATER HEATER
		W	WASHER
		WT.	WEIGHT
		WIN.	WINDOW
		W.M.	WIRE MESH
		W	WITH
		WD	WOOD
		WFCM	WOOD FRAME CONSTRUCTION MANUAL



SHEET INDEX:

- 1 COVER SHEET
- 2 FOUNDATION PLAN
- 3 FLOOR PLAN
- 4 EXTERIOR VIEWS
- 5 EXTERIOR VIEWS
- 6 SECTIONS & CABINETS
- 7 ROOF PLAN
- 8 ELECTRICAL PLAN

BB-3044


CODE DISCLAIMER:
 1. THESE PLANS WERE DESIGNED TO MEET IRC 2015 AT THE TIME OF THEIR CREATION AND MORE SPECIFICALLY THE MINIMAL LOCAL CODES OF THE SOUTH MISSISSIPPI AREA. IT IS HIGHLY RECOMMENDED THAT THESE PLANS BE REVIEWED BY A LOCAL STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION.
 2. BEAMS AND FLOOR JOISTS ARE NOT SIZED DUE TO THE MANY GEOGRAPHIC LOCATIONS THESE PLANS ARE SOLD. THESE ITEMS SHALL BE SIZED BY A LOCAL ENGINEER OR MANUFACTURER.
 3. ALL CEILING & FLOOR JOISTS (IF CONVENTIONAL FRAMING) SHOULD BE SIZED USING THE LATEST VERSION OF THE IRC OR APPLICABLE CODES AT SITE TO MEET THE LOCAL REQUIREMENTS SUCH AS SNOW LOADS AND OTHER FACTORS. THE CEILING JOISTS SIZES LABELED (IF PRESENT) WERE SIZED USING THE 2015 IRC AT THE TIME OF THEIR CREATION. THEY MUST BE VERIFIED AND MODIFIED AS REQUIRED TO MEET THE LATEST EDITION OF THE (IRC) INTERNATIONAL RESIDENTIAL CODE.
 4. ALL FOUNDATIONS AND FOOTING DETAILS SHALL BE REVIEWED AND APPROVED BY A LOCAL ENGINEER.
 5. CONTRACTOR SHALL PROVIDE ALL HIGH WIND STRAPPING AND ANCHOR BOLTS AS REQUIRED BY THE LOCAL CODE REQUIREMENTS AND THE LATEST VERSION OF THE IRC.



Date: 12.05.18
 Drawn By: J.A.B.


SHEET NUMBER

1

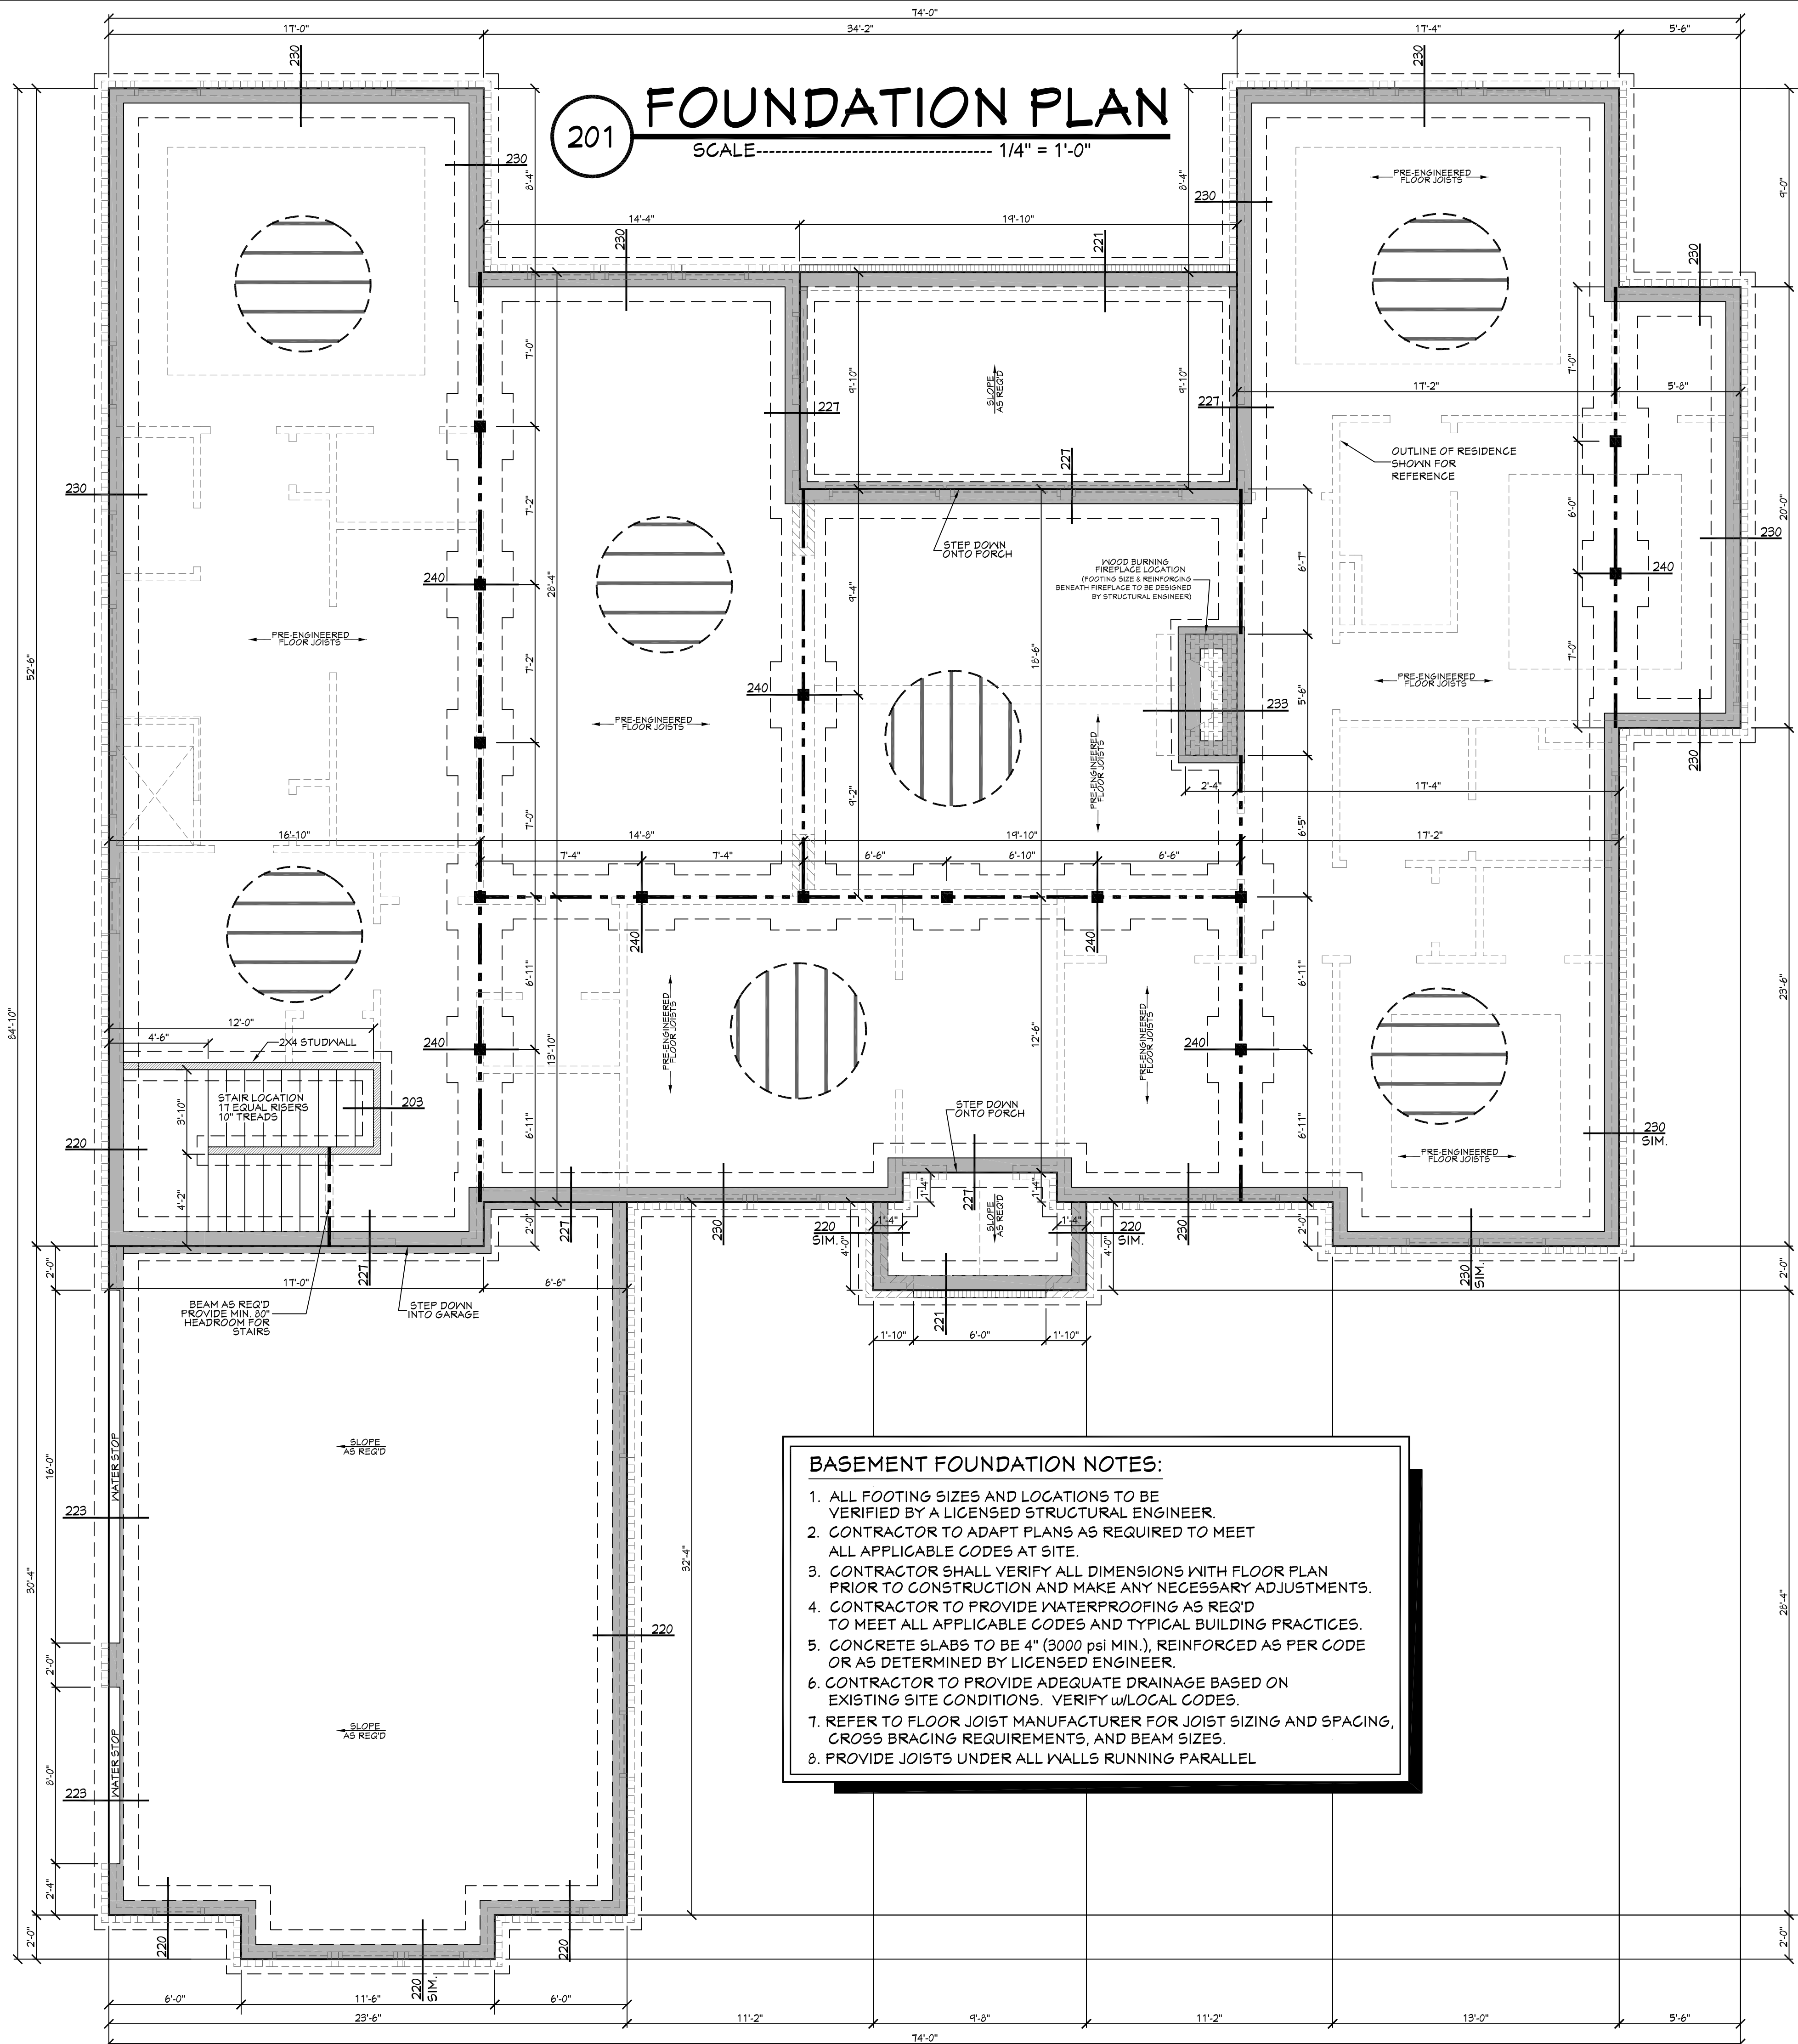

201 FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

- BASEMENT FOUNDATION NOTES:**
1. ALL FOOTING SIZES AND LOCATIONS TO BE VERIFIED BY A LICENSED STRUCTURAL ENGINEER.
 2. CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE.
 3. CONTRACTOR SHALL VERIFY ALL DIMENSIONS WITH FLOOR PLAN PRIOR TO CONSTRUCTION AND MAKE ANY NECESSARY ADJUSTMENTS.
 4. CONTRACTOR TO PROVIDE WATERPROOFING AS REQ'D TO MEET ALL APPLICABLE CODES AND TYPICAL BUILDING PRACTICES.
 5. CONCRETE SLABS TO BE 4" (3000 PSI MIN.), REINFORCED AS PER CODE OR AS DETERMINED BY LICENSED ENGINEER.
 6. CONTRACTOR TO PROVIDE ADEQUATE DRAINAGE BASED ON EXISTING SITE CONDITIONS. VERIFY W/LOCAL CODES.
 7. REFER TO FLOOR JOIST MANUFACTURER FOR JOIST SIZING AND SPACING, CROSS BRACING REQUIREMENTS, AND BEAM SIZES.
 8. PROVIDE JOISTS UNDER ALL WALLS RUNNING PARALLEL

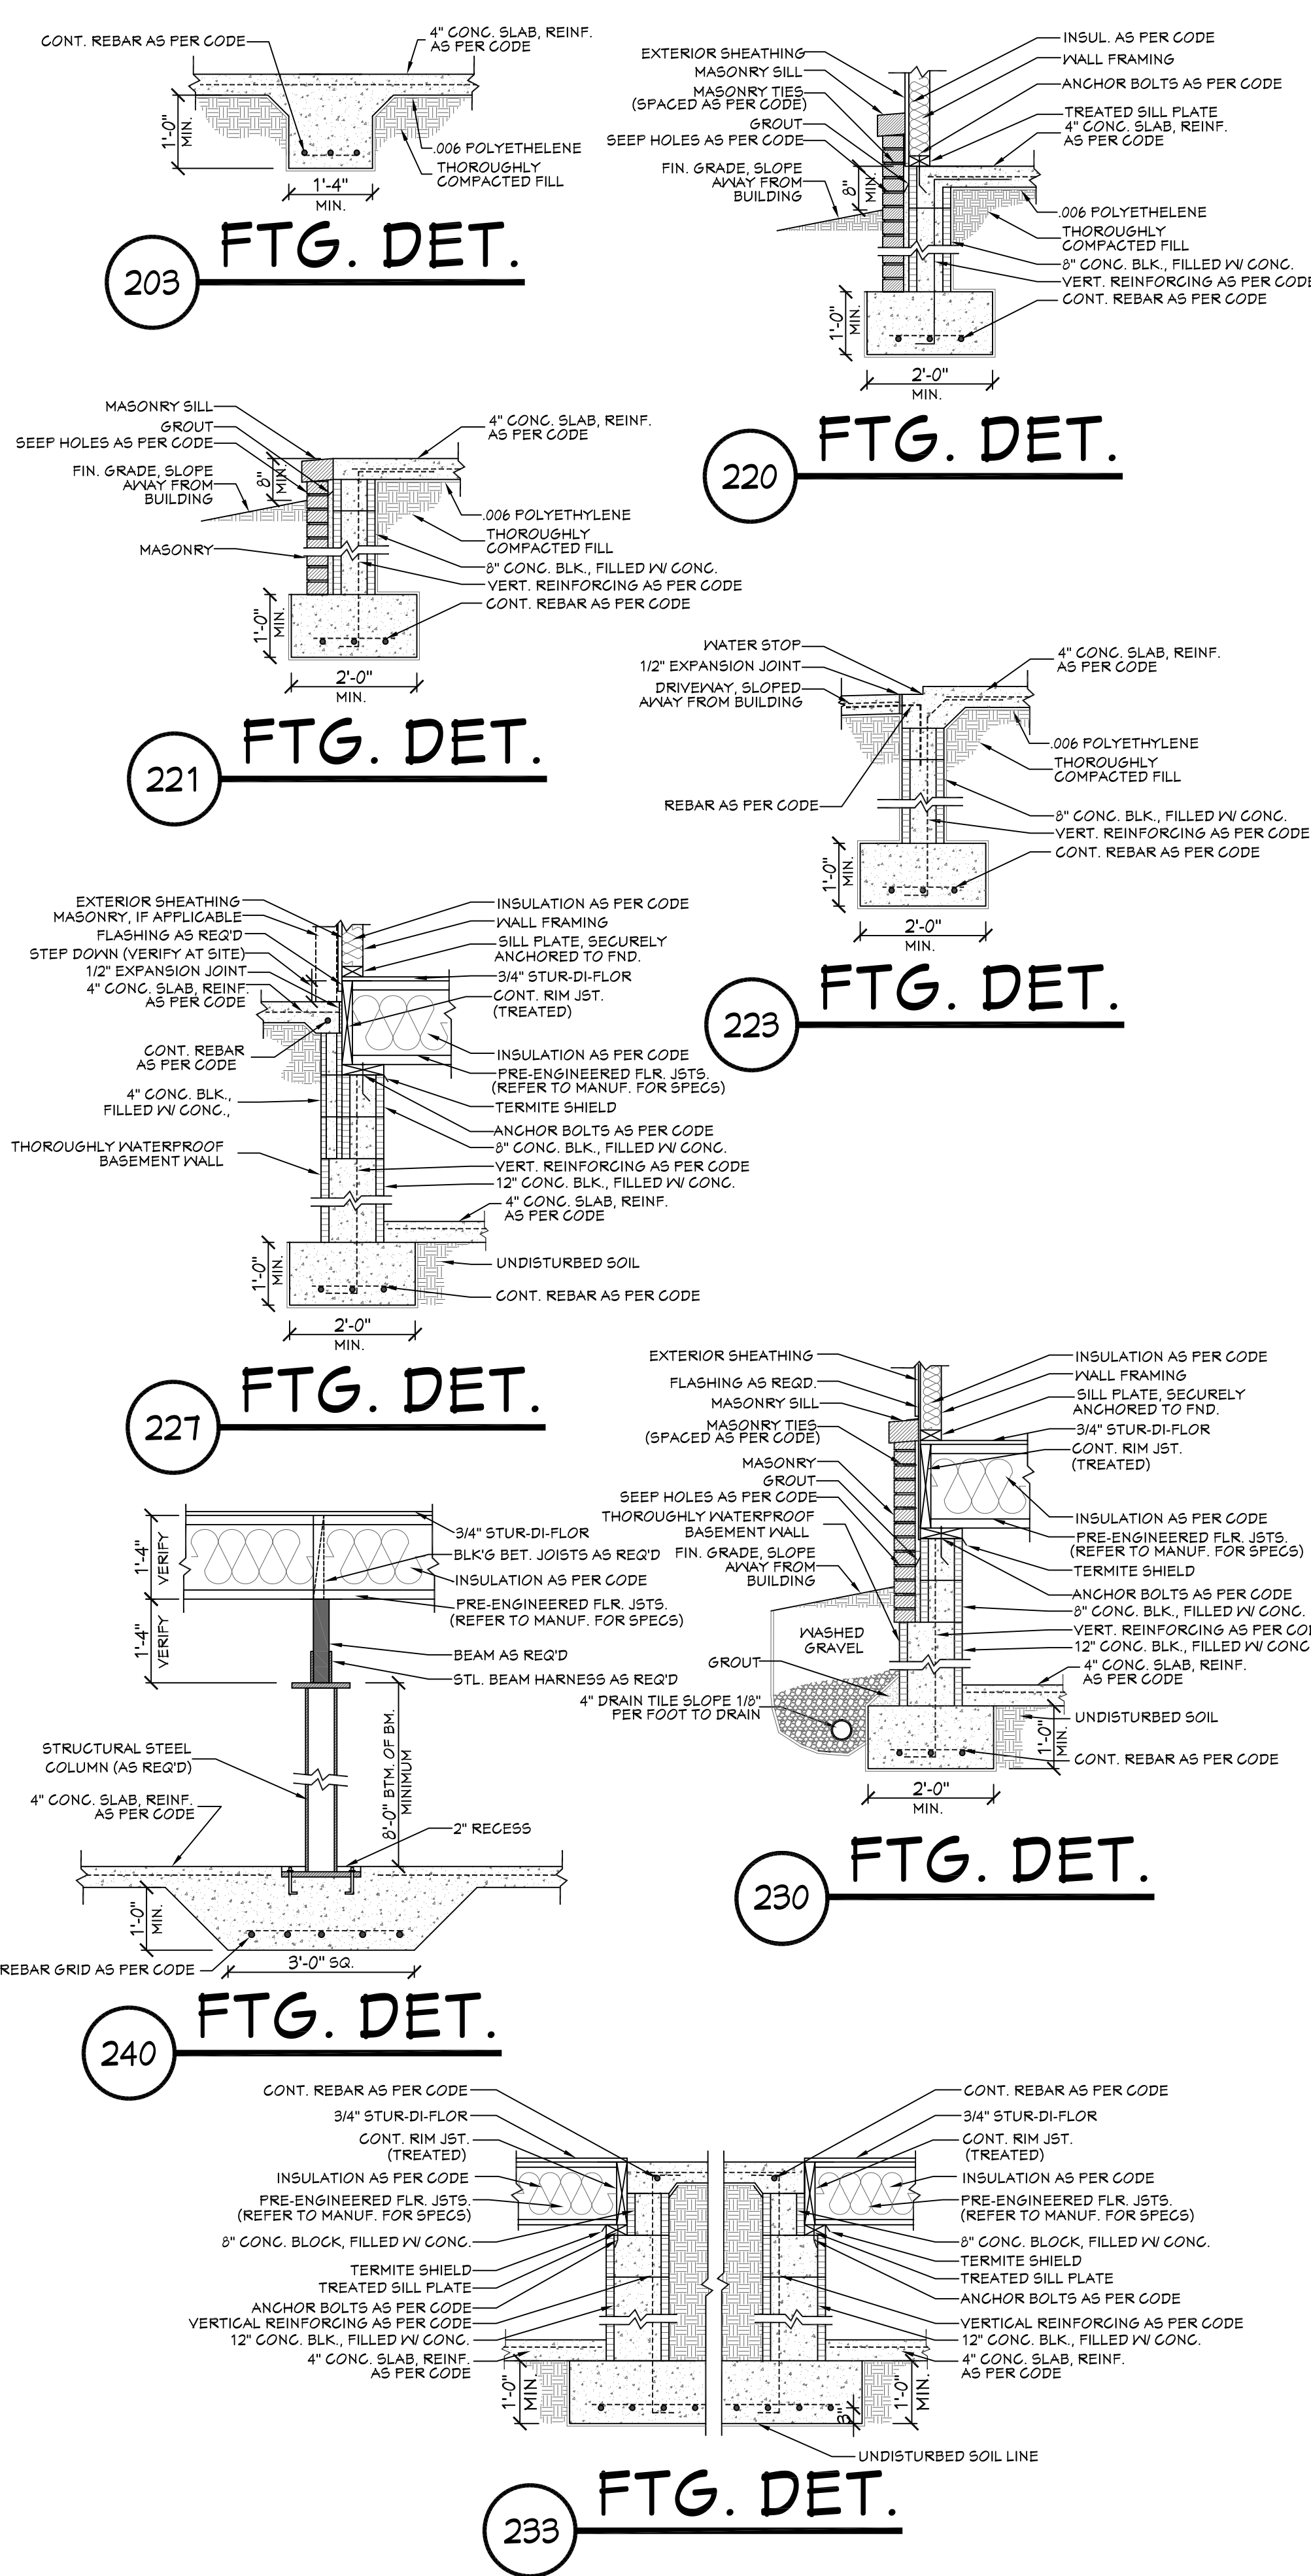

- NOTES:**
- 1.) CONTRACTOR TO PROVIDE EGRESS FOR BASEMENT. (VERIFY REQUIREMENTS W/LOCAL CODES.)
 - 2.) PRE-ENGINEERED FLOOR JOISTS ARE SHOWN. REFER TO MANUFACTURER FOR FURTHER DETAILS.

Designing Homes
HOUSE PLAN ZONE
Building Relationships

Website:
www.HFZplans.com

Email:
sales@hpfzplans.com

Phone:
601.336.3254

Fax:
1.800.574.1387


N · C · B · D · C
NATIONAL COUNCIL OF BUILDING DESIGNERS
CERTIFICATION

JONATHAN L. BOONE
CERTIFICATION NO. 25-137

Pre-Drawn Plan ID:
BB-3044

Date: 12.05.18
Drawn By: C.T.B.
Plan number:
Project Name:

SHEET NUMBER
2

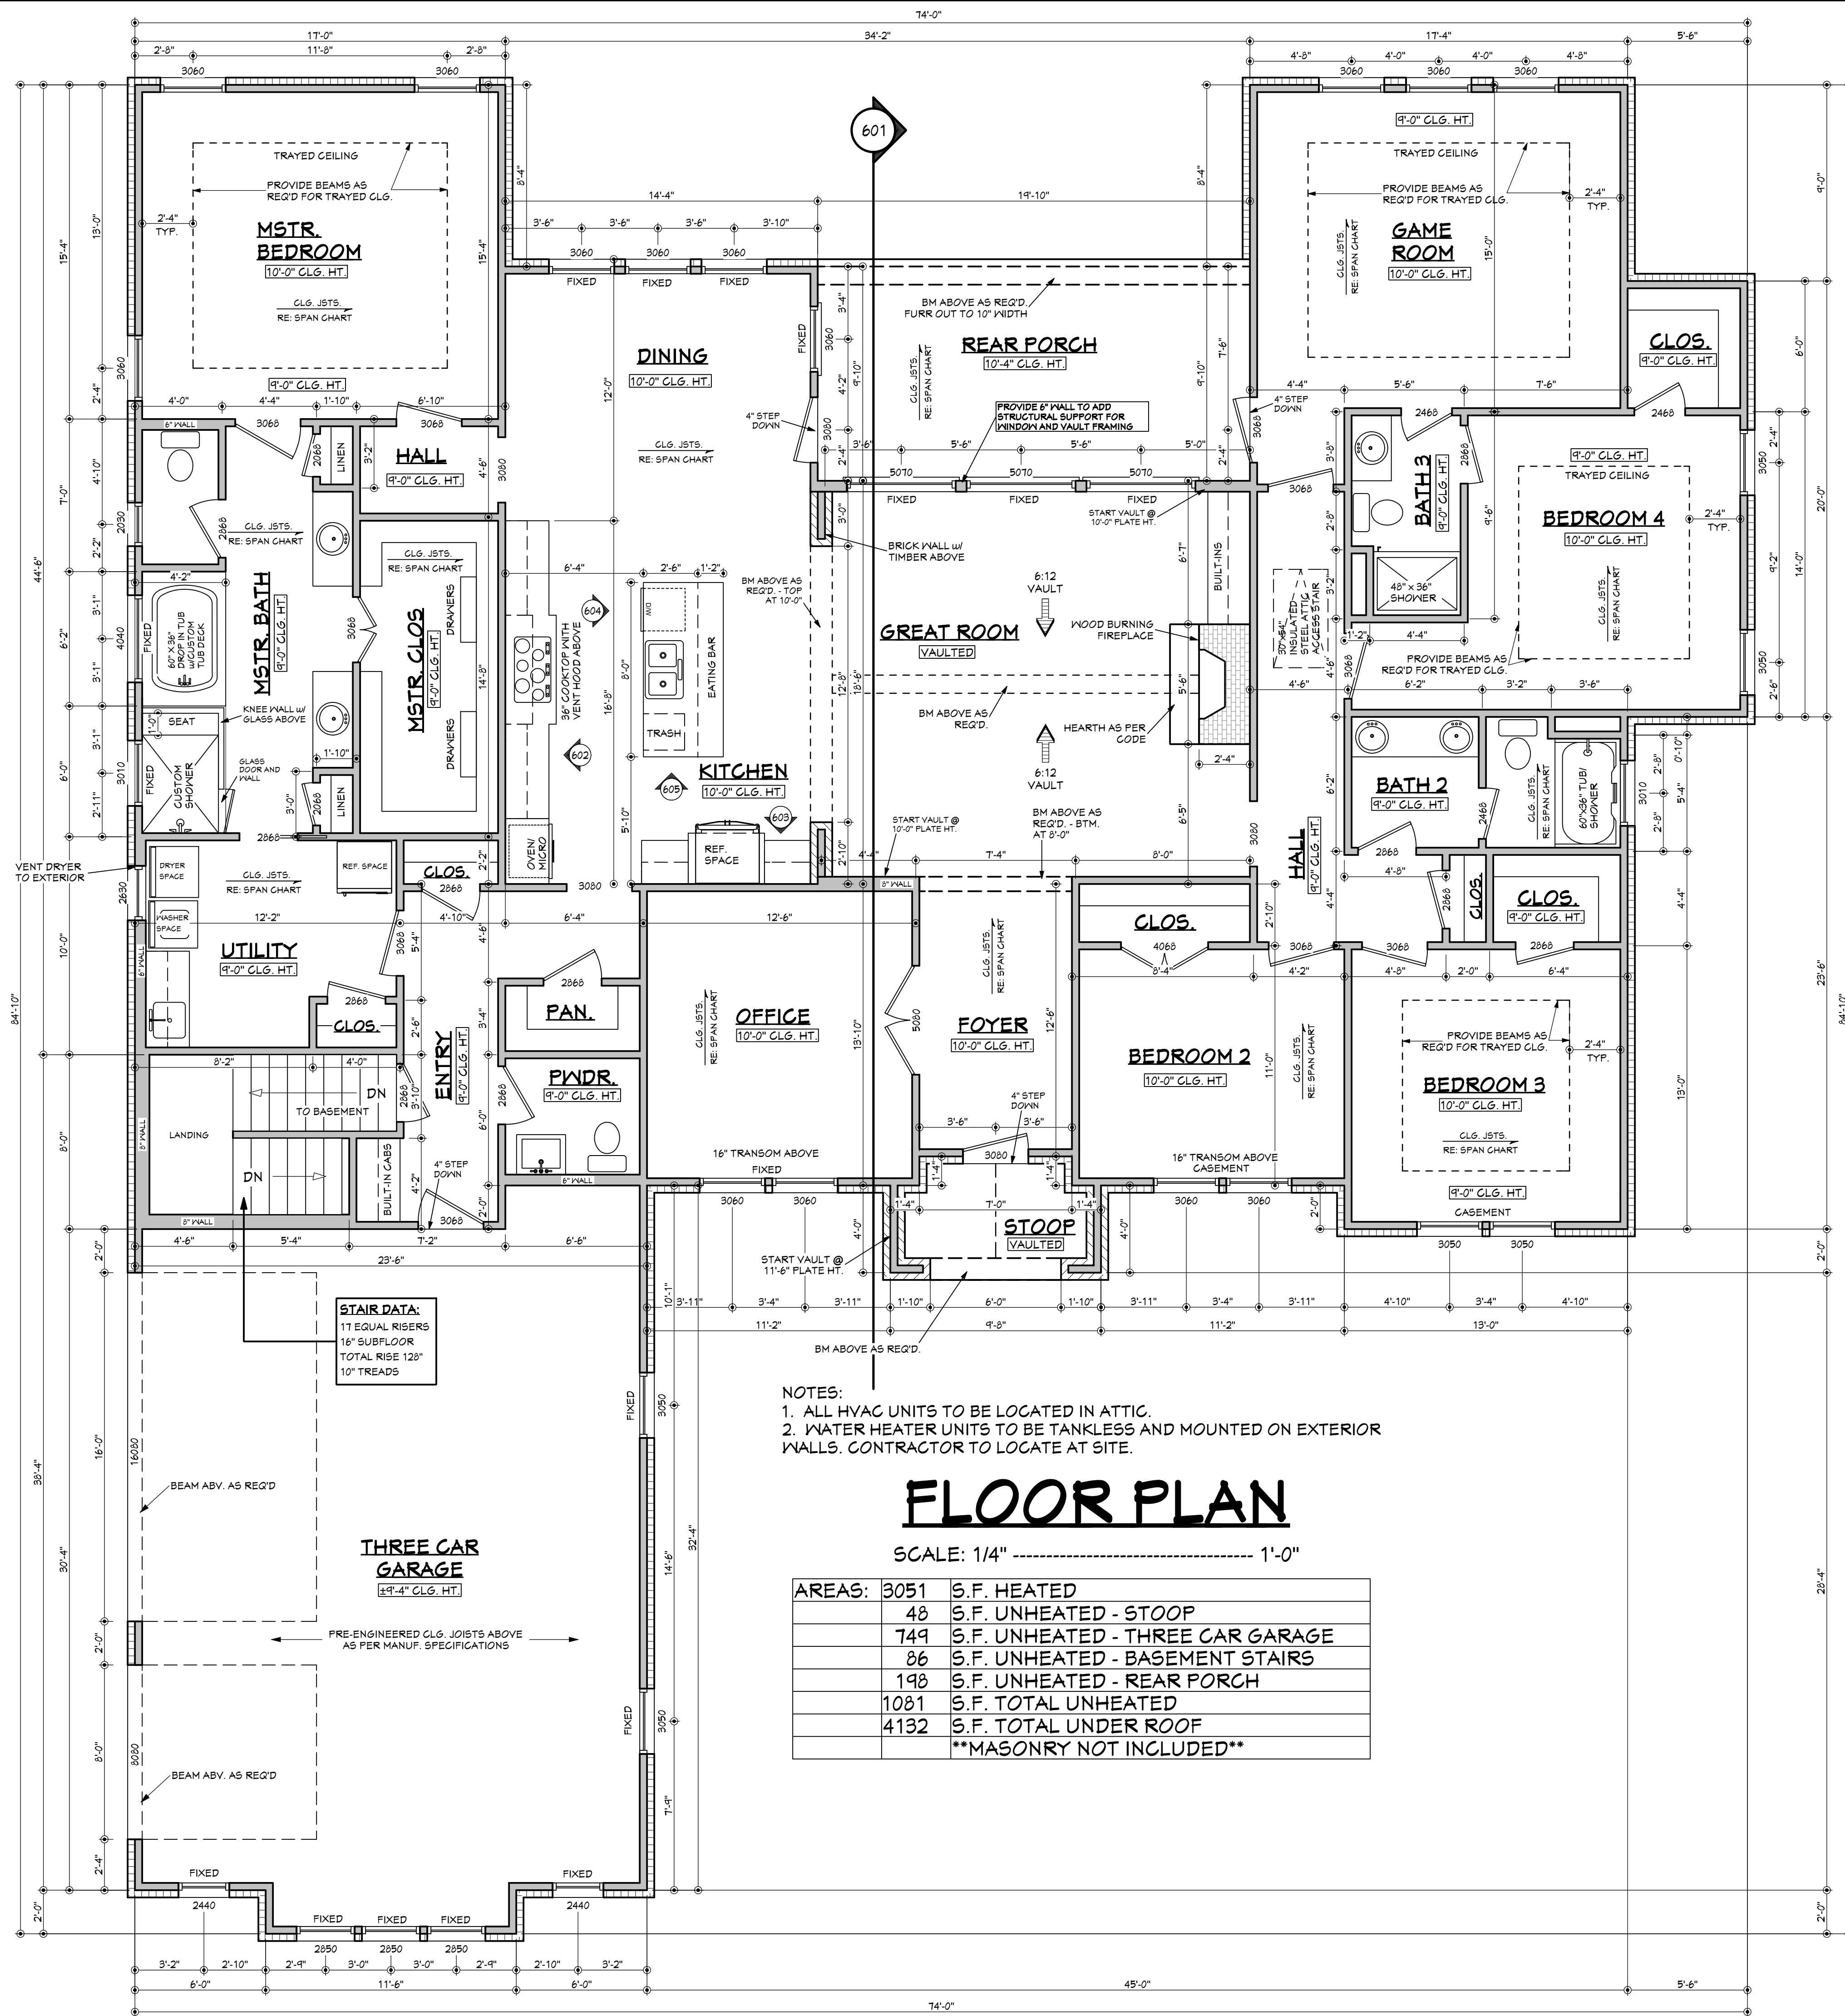


FLOOR PLAN

SCALE: 1/4" = 1'-0"

AREAS:	3051	S.F. HEATED
	48	S.F. UNHEATED - STOOP
	749	S.F. UNHEATED - THREE CAR GARAGE
	86	S.F. UNHEATED - BASEMENT STAIRS
	198	S.F. UNHEATED - REAR PORCH
	1081	S.F. TOTAL UNHEATED
	4132	S.F. TOTAL UNDER ROOF
		MASONRY NOT INCLUDED

NOTES:

- ALL DIMENSIONS & SITE CONDITIONS TO BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION.
- ALL FINISHES (INTERIOR & EXTERIOR) TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
- VERIFY ALL DOOR AND WINDOW STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION. MANUFACTURER TO SUPPLY ALL ROUGH OPENING SIZES.
- CONTRACTOR TO VERIFY ALL CLEARANCES OF ALL DOORS, WINDOWS AND OTHER ITEMS THAT ARE CRITICAL, PRIOR TO CONSTRUCTION.
- CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE.
- ALL BEAMS TO BE SIZED BY A LICENSED STRUCTURAL ENGINEER.
- FORCHES, BALCONIES OR RAISED FLOOR SURFACES LOCATED MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW AT ANY POINT WITHIN 36 INCHES HORIZONTALLY SHALL HAVE GUARDS NOT LESS THAN 36 INCHES IN HEIGHT. OPEN SIDES OF STAIRS WITH A TOTAL RISE OF MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDS NOT LESS THAN 34 INCHES IN HEIGHT MEASURED VERTICALLY FROM THE NOSING OF THE TREADS. INSECT SCREENING SHALL NOT BE CONSIDERED AS A GUARD. IRC 2015, R312.1.1 & R312.1.2
- M1305.1.3 APPLIANCES IN ATTICS. ATTICS CONTAINING APPLIANCES SHALL BE PROVIDED WITH AN OPENING AND A CLEAR AND UNOBSTRUCTED PASSAGEWAY LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE, BUT NOT LESS THAN 30 INCHES HIGH AND 22 INCHES WIDE AND NOT MORE THAN 20 FEET LONG MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY FROM THE OPENING TO THE APPLIANCE. THE PASSAGEWAY SHALL HAVE CONTINUOUS SOLID FLOORING IN ACCORDANCE WITH CHAPTER 5 NOT LESS THAN 24 INCHES WIDE. A LEVEL SERVICE SPACE AT LEAST 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PRESENT ALONG ALL SIDES OF THE APPLIANCE WHERE ACCESS IS REQUIRED. THE CLEAR ACCESS OPENING DIMENSIONS SHALL BE A MINIMUM OF 20 INCHES BY 30 INCHES, AND LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE.
- EXCEPTIONS:
 - THE PASSAGEWAY AND LEVEL SERVICE SPACE ARE NOT REQUIRED WHERE THE APPLIANCE CAN BE SERVICED AND REMOVED THROUGH THE REQUIRED OPENING.
 - WHERE THE PASSAGEWAY IS UNOBSTRUCTED AND NOT LESS THAN 6 FEET HIGH AND 22 INCHES WIDE FOR ITS ENTIRE LENGTH, THE PASSAGEWAY SHALL BE NOT MORE THAN 50 FEET LONG.
- APPLIANCE ACCESS FOR INSPECTION SERVICE, REPAIR AND REPLACEMENT. APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION, OTHER APPLIANCES, OR ANY OTHER PIPING OR DUCTS NOT CONNECTED TO THE APPLIANCE BEING INSPECTED, SERVICED, REPAIRED OR REPLACED. A LEVEL WORKING SPACE AT LEAST 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PROVIDED IN FRONT OF THE CONTROL SIDE TO SERVICE AN APPLIANCE. INSTALLATION OF ROOM HEATERS SHALL BE PERMITTED WITH AT LEAST AN 18-INCH WORKING SPACE. A PLATFORM SHALL NOT BE REQUIRED FOR ROOM HEATERS.
- M1305.1.1 FURNACES AND AIR HANDLERS. FURNACES AND AIR HANDLERS WITHIN COMPARTMENTS OR ALCOVES SHALL HAVE A MINIMUM WORKING SPACE CLEARANCE OF 3 INCHES ALONG THE SIDES, BACK AND TOP WITH A TOTAL WIDTH OF THE ENCLOSED SPACE BEING AT LEAST 12 INCHES WIDER THAN THE FURNACE OR AIR HANDLER. FURNACES HAVING A FIREBOX OPEN TO THE ATMOSPHERE SHALL HAVE AT LEAST A 6-INCH WORKING SPACE ALONG THE FRONT COMBUSTION CHAMBER SIDE. COMBUSTION AIR OPENINGS AT THE REAR OR SIDE OF THE COMPARTMENT SHALL COMPLY WITH THE REQUIREMENTS OF CHAPTER 17. EXCEPTION: THIS SECTION SHALL NOT APPLY TO REPLACEMENT APPLIANCES INSTALLED IN EXISTING COMPARTMENTS AND ALCOVES WHERE THE WORKING SPACE CLEARANCES ARE IN ACCORDANCE WITH THE EQUIPMENT OR APPLIANCE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS, TOOLS OR SPECIAL KNOWLEDGE. WINDOW OPENING CONTROL DEVICES COMPLYING WITH ASTM F 2090 SHALL BE PERMITTED FOR USE ON WINDOWS SERVING AS A REQUIRED EMERGENCY ESCAPE AND RESCUE OPENING. ALL SLEEPING ROOMS TO HAVE AN EXTERIOR ACCESS THROUGH A DOOR OR WINDOW WITH A MINIMUM OF 5.7 SQUARE FEET NET CLEAR OPENING AS PER IRC 2015 R310.2.1. EXCEPTION: GRADE FLOOR OR BELOW GRADE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5 SQUARE FEET. MAXIMUM SILL HEIGHT TO BE 44 INCHES. MINIMUM NET CLEAR OPENING HEIGHT TO BE 24 INCHES. MINIMUM NET CLEAR OPENING WIDTH TO BE 20 INCHES.
- ALL RETURN AIR GRILLS ARE TO BE LOCATED TO COMPLY WITH SECTION M1602 OF THE IRC 2015.
- ALL SQUARE FOOTAGE MEASUREMENTS ARE APPROXIMATE AND MAY DIFFER FROM ACTUAL CONSTRUCTED RESIDENCE OR BUILDING.
- FIRE SPRINKLER SYSTEM TO BE DESIGNED AND INSTALLED (IF REQUIRED BY LOCAL CODES) AS PER THE IRC 2015 AND BY A LICENSED PROFESSIONAL IN THE AREA OF CONSTRUCTION.
- ALL BATHROOM EXHAUST VENTS SHALL BE VENTED DIRECTLY TO THE EXTERIOR OF THE HOME AND NOT INTO THE ATTIC. IRC 2015, M1507.2

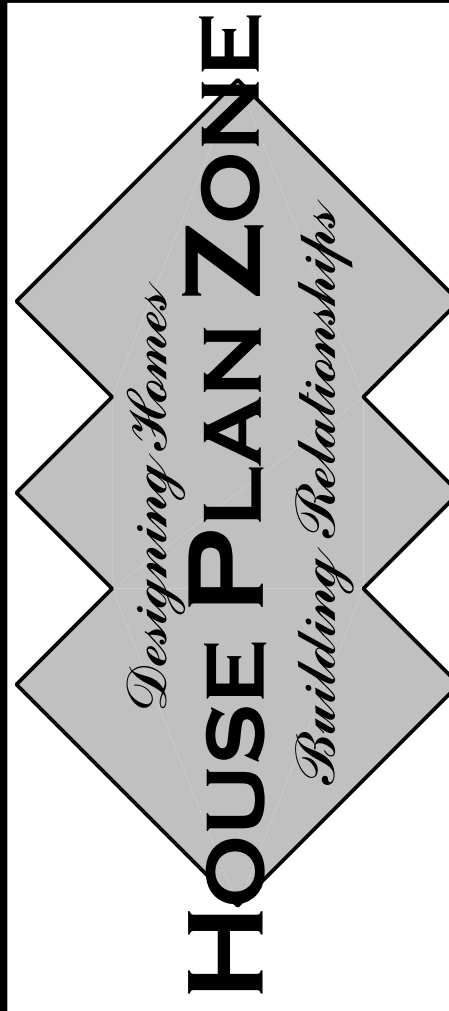

Website:
www.HPZplans.com
 Email:
sales@hpzplans.com
 Phone:
 601.336.3254
 Fax:
 1.800.574.1387




Pre-Drawn Plan ID:
BB-3044

Date: 12.05.18
 Drawn By: J.A.B.
 Project Name:

SHEET NUMBER
3


House Plan Zone, LLC has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the contractor is responsible for verifying all dimensions, materials, and finishes. House Plan Zone, LLC is not responsible for any damages, including structural failures, resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

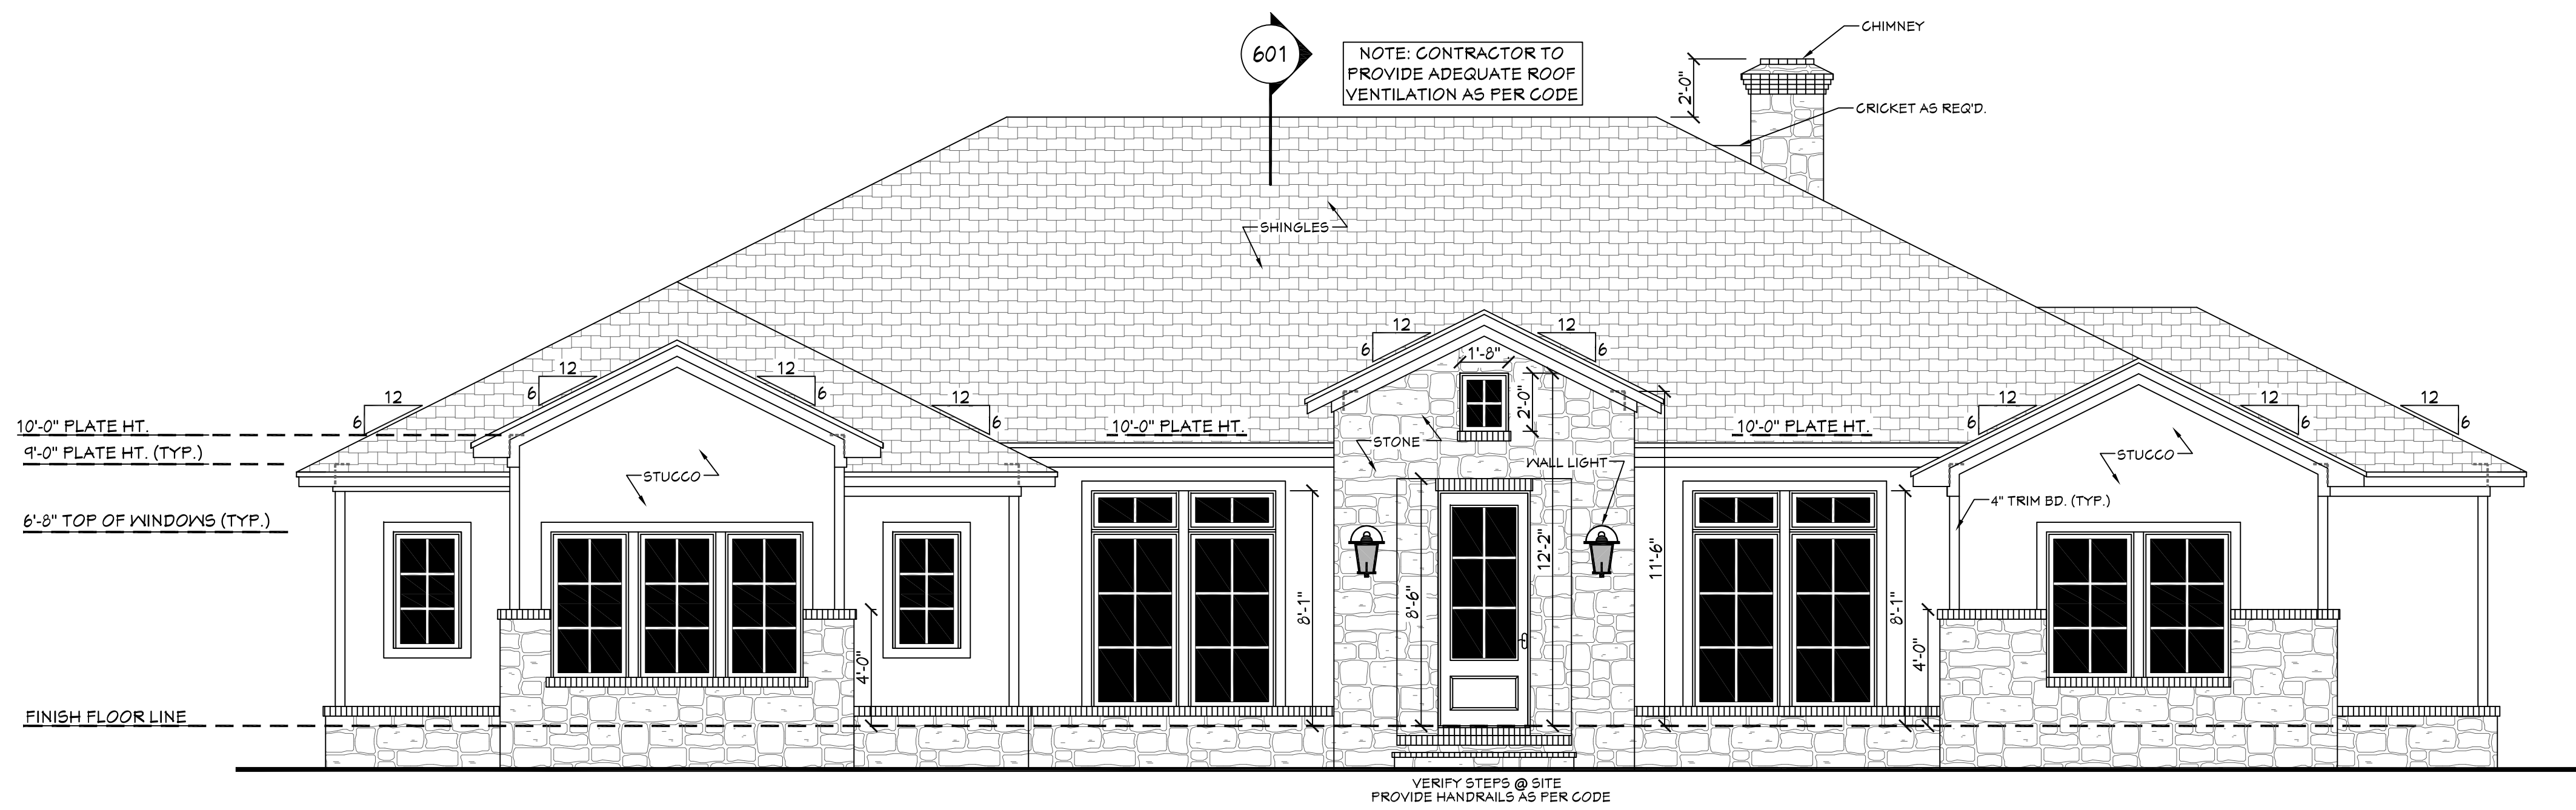

401 **FRONT VIEW**
SCALE-----1/4" = 1'-0"

EXTERIOR ELEVATION NOTES:

1. CONTRACTOR TO VERIFY ALL WINDOW AND DOOR STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION.
2. PROVIDE STEPS AND GUARD RAILS AS PER CODE BASED ON SITE CONDITIONS.
3. GROUND LINES SHOWN FOR REFERENCE ONLY AND VARY DEPENDING ON SITE CONDITIONS.
4. ALL FINISH MATERIALS TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
5. REFER TO TYPICAL WALL DETAIL FOR FRAMING METHODS AND OTHER MISC. INFORMATION.
6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.

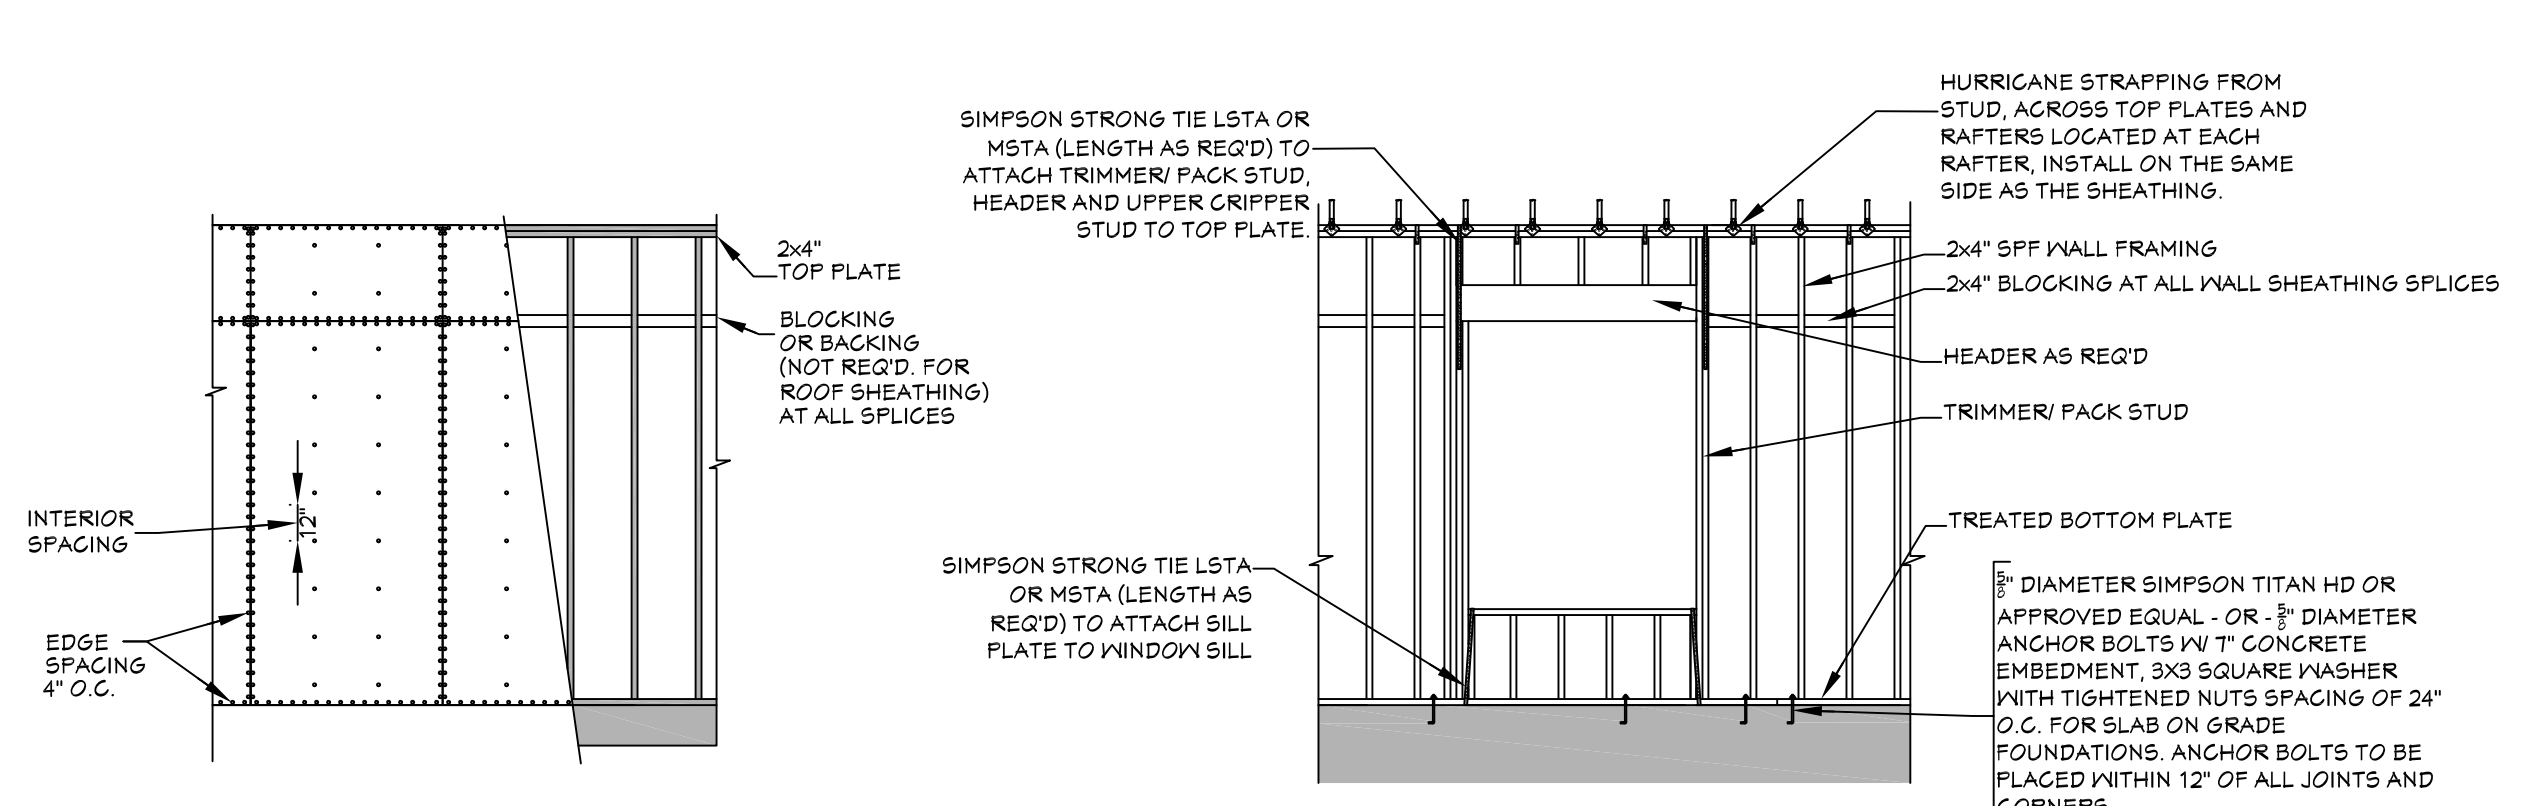

NAIL SIZE SPACING FOR WALL SHEATHING

8d NAILS
MIN. OF 7/16" O.S.B.
EDGE SPACING = 4" O.C.
INTERIOR SPACING = 12" O.C.


NAIL SIZE SPACING FOR ROOF SHEATHING

8d NAILS
MIN. OF 7/16" O.S.B.
EDGE SPACING = 4" O.C.
INTERIOR SPACING = 4" O.C.

NOTES:

1. ALL EXTERIOR SHEATHING TO EXTEND FROM BOTTOM OF BOTTOM PLATE TO THE TOP OF THE TOP PLATES.
2. PROVIDE 2X4 OR GREATER COLLAR TIES ON EACH RAFTER IN THE UPPER THIRD OF ATTIC AND ATTACHED TO RAFTERS WITH 5 - 10d NAILS ON EACH SIDE.
3. SHINGLES OR OTHER ROOF MATERIALS TO BE FASTENED AS PER MANUFACTURERS INSTRUCTIONS FOR HIGH WIND APPLICATIONS.
4. EXTERIOR WALL FINISHES TO BE INSTALLED AS PER MANUFACTURERS INSTRUCTIONS BASED ON HIGH WIND APPLICATIONS.


WALL/ROOF FASTENING DETAILS
SCALE-----1/4" = 1'-0"

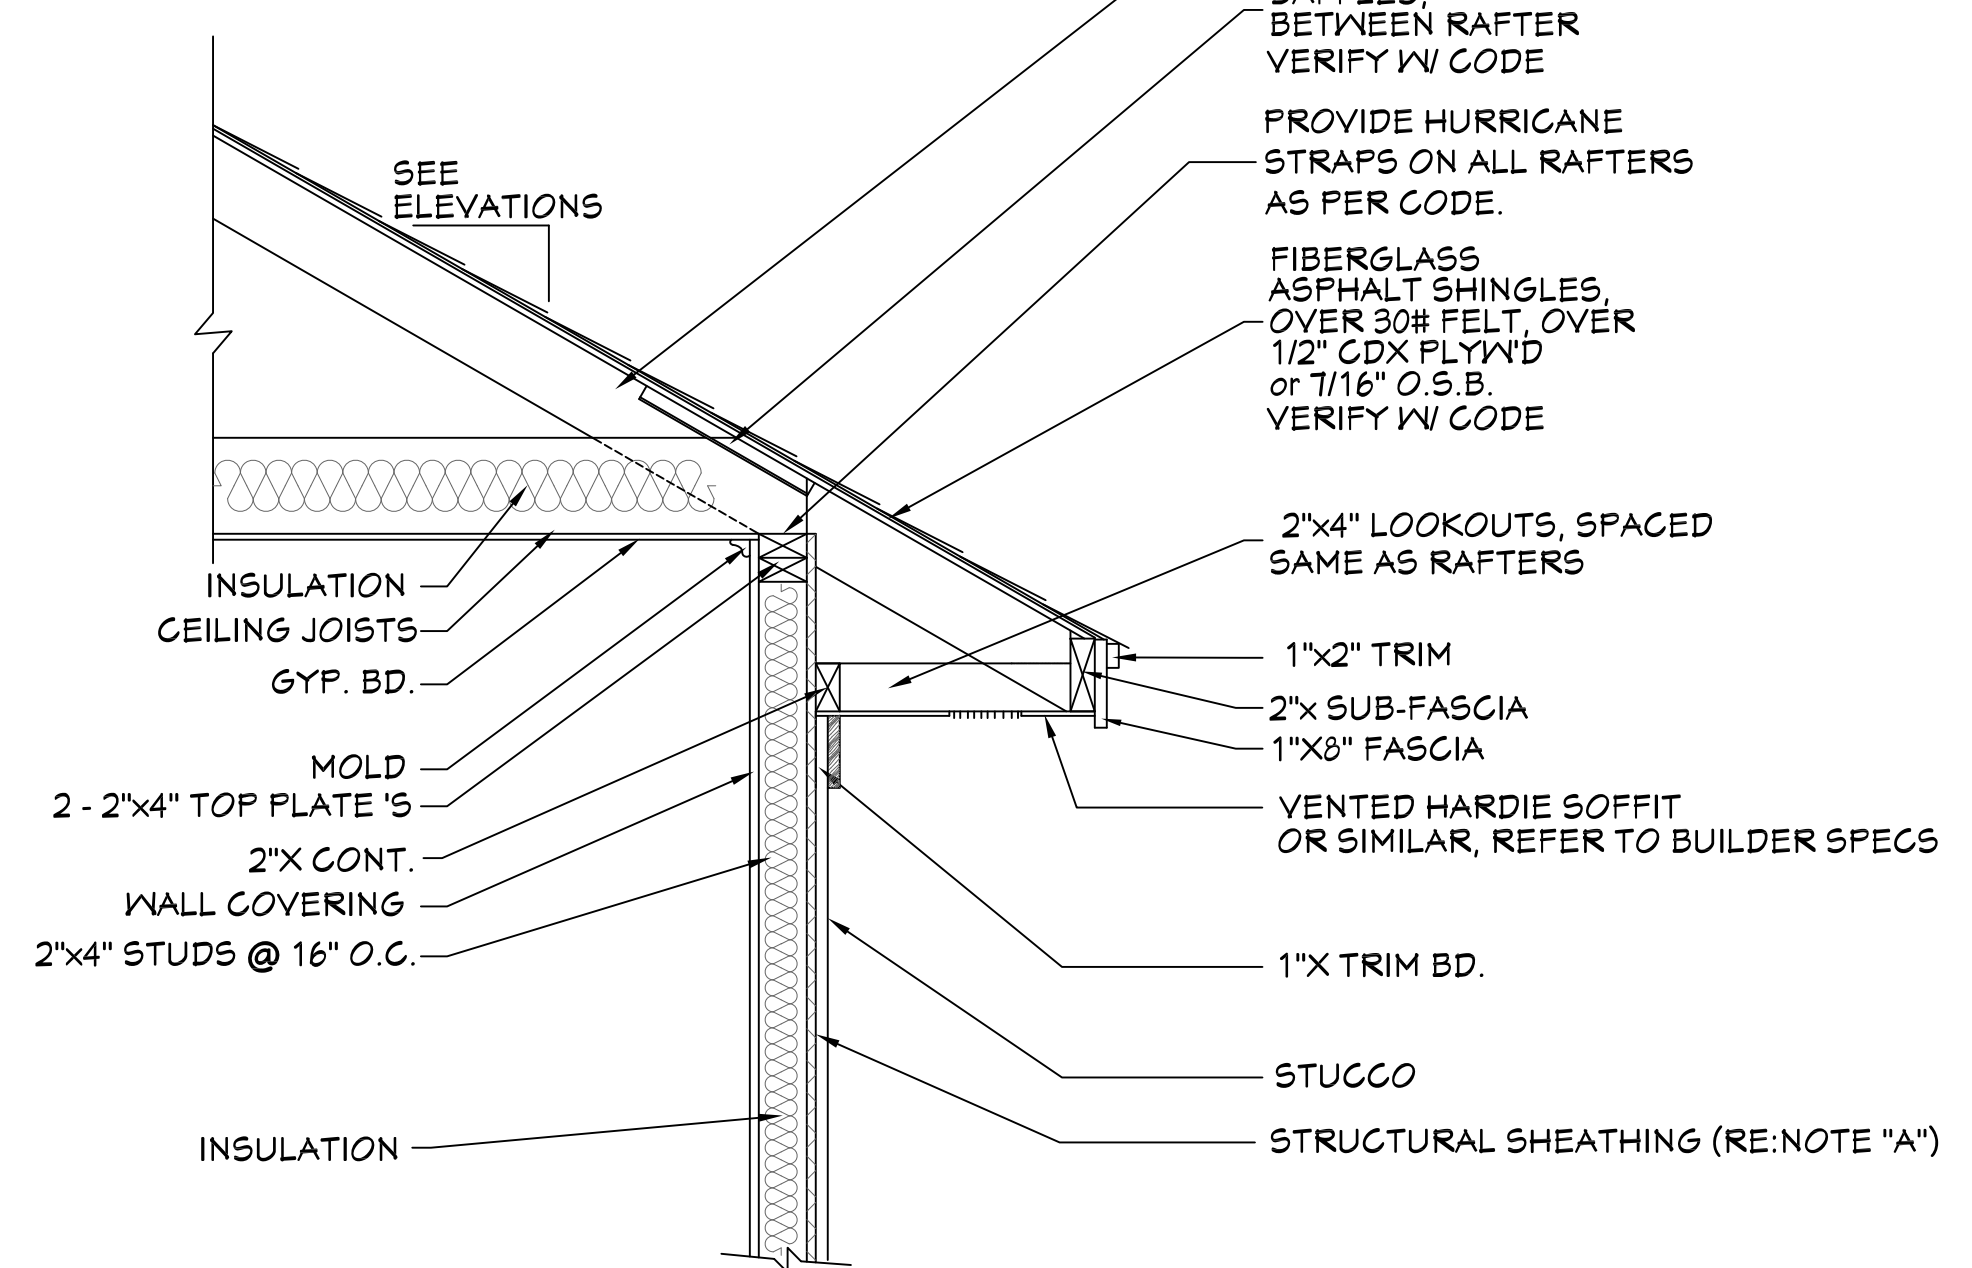

NOTE "A": PROVIDE A MINIMUM OF 7/16" STRUCTURAL WOOD PANEL ATTACHED W/ 8d COMMON OR 10d BOX NAILS AT 4" SPACING ON EDGE AND 12" IN FIELD.

NOTE "B": CORNICE DETAIL FOR REFERENCE ONLY. REFER TO BUILDER SPECS FOR ACTUAL MATERIALS.

403 **TYP. CORNICE DETAIL**
SCALE-----3/4" = 1'-0"

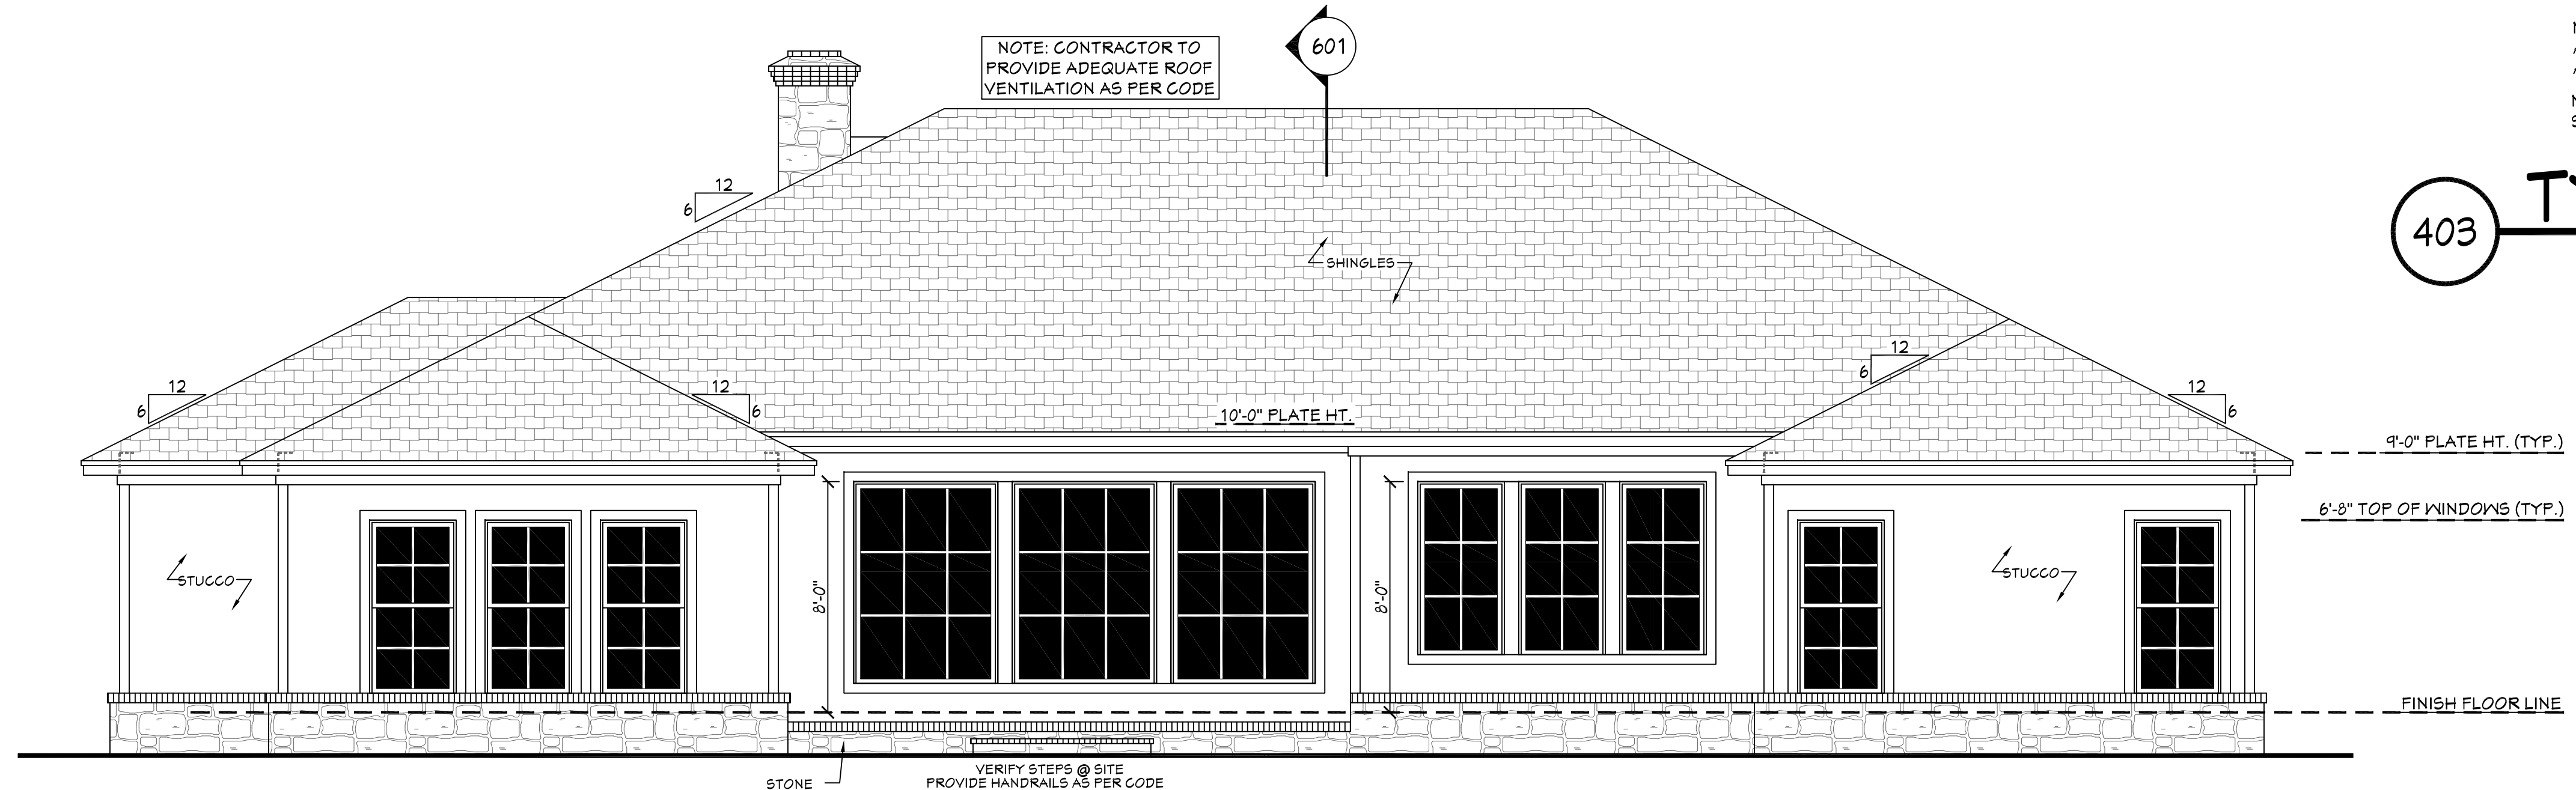

402 **REAR VIEW**
SCALE-----1/4" = 1'-0"


Designing Homes
HOUSE PLAN ZONE
 Building Relationships

Website:
www.HFZplans.com

Email:
sales@hpfzplans.com

Phone:
601.336.3254

Fax:
1.800.574.1387

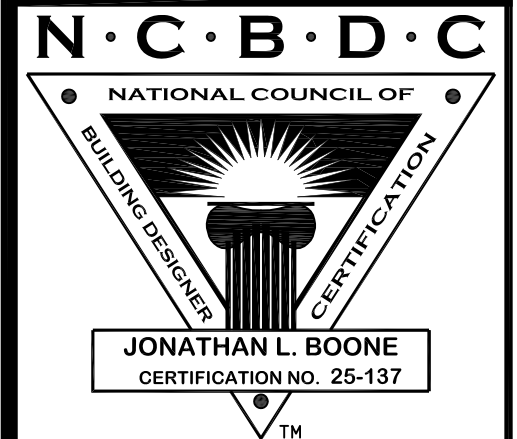


Pre-Drawn Plan ID:
BB-3044

Date:
12.05.18

Drawn By:
C.T.B.

SHEET NUMBER
4


House Plan Zone, LLC has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes full responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions may be required by local building codes. All dimensions to be verified on site prior to construction. A foundation plan has been included in these plans. It is general in nature and shall be verified by a licensed engineer prior to construction.

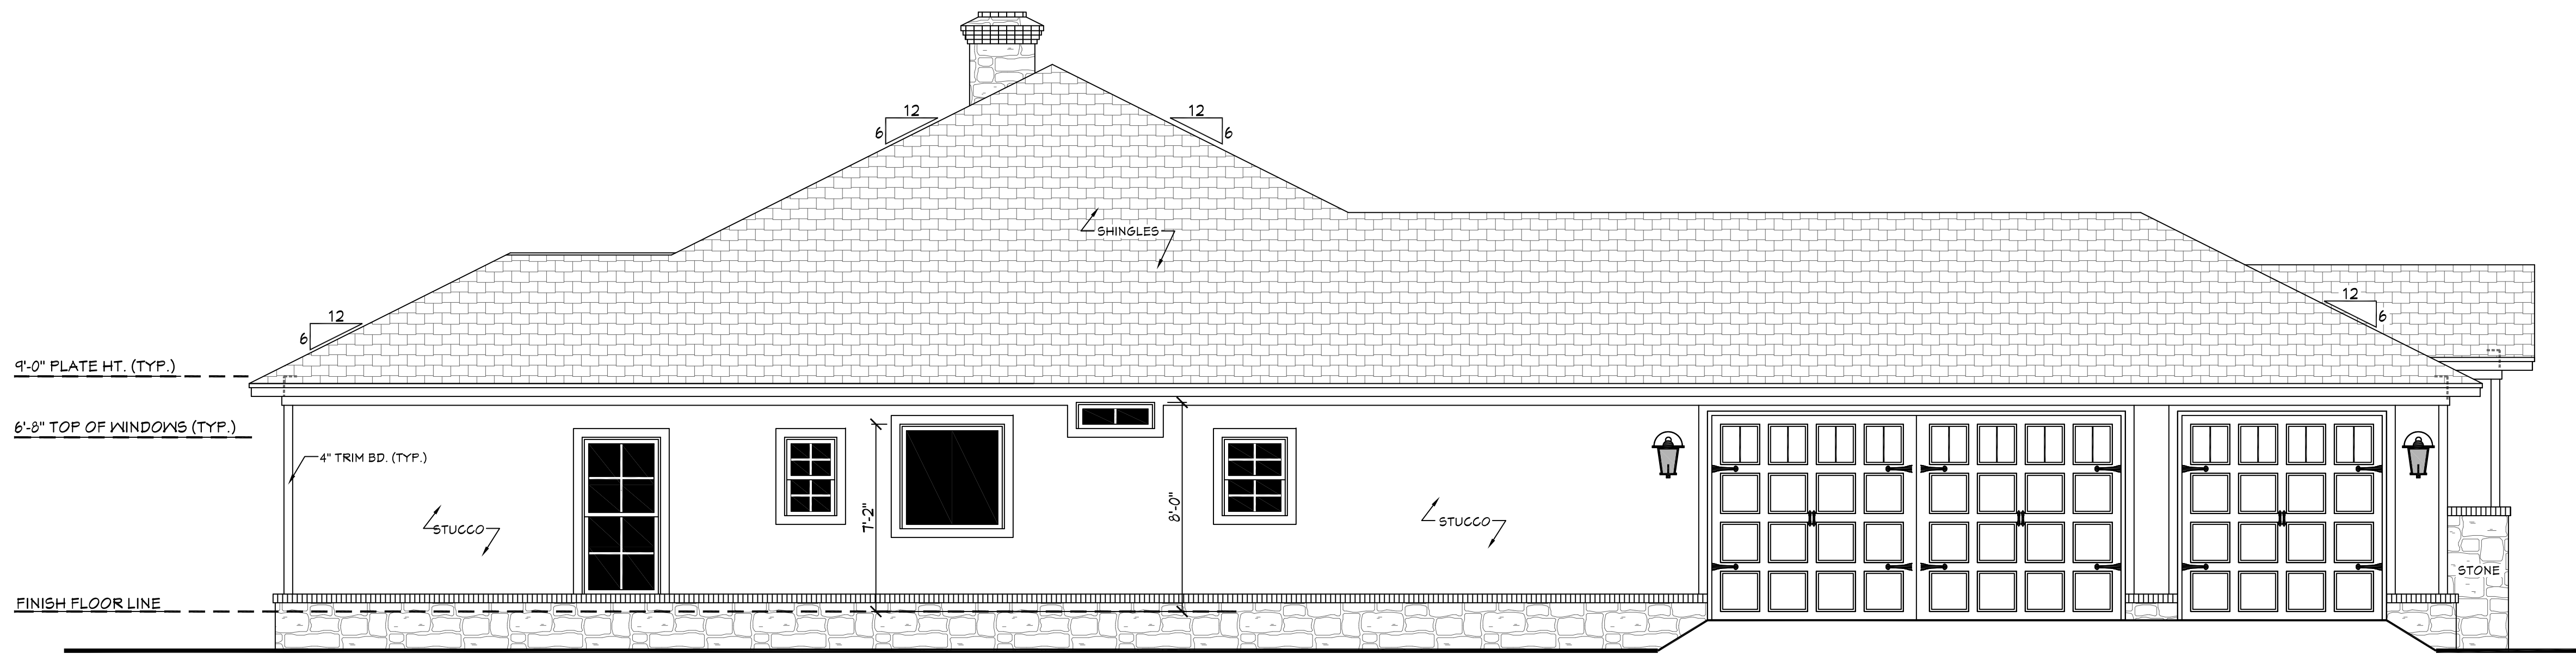

501 LEFT VIEW
SCALE----- 1/4" = 1'-0"

EXTERIOR ELEVATION NOTES:

1. CONTRACTOR TO VERIFY ALL WINDOW AND DOOR STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION.
2. PROVIDE STEPS AND GUARD RAILS AS PER CODE BASED ON SITE CONDITIONS.
3. GROUND LINES SHOWN FOR REFERENCE ONLY AND VARY DEPENDING ON SITE CONDITIONS.
4. ALL FINISH MATERIALS TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
5. REFER TO TYPICAL WALL DETAIL FOR FRAMING METHODS AND OTHER MISC. INFORMATION.
6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.

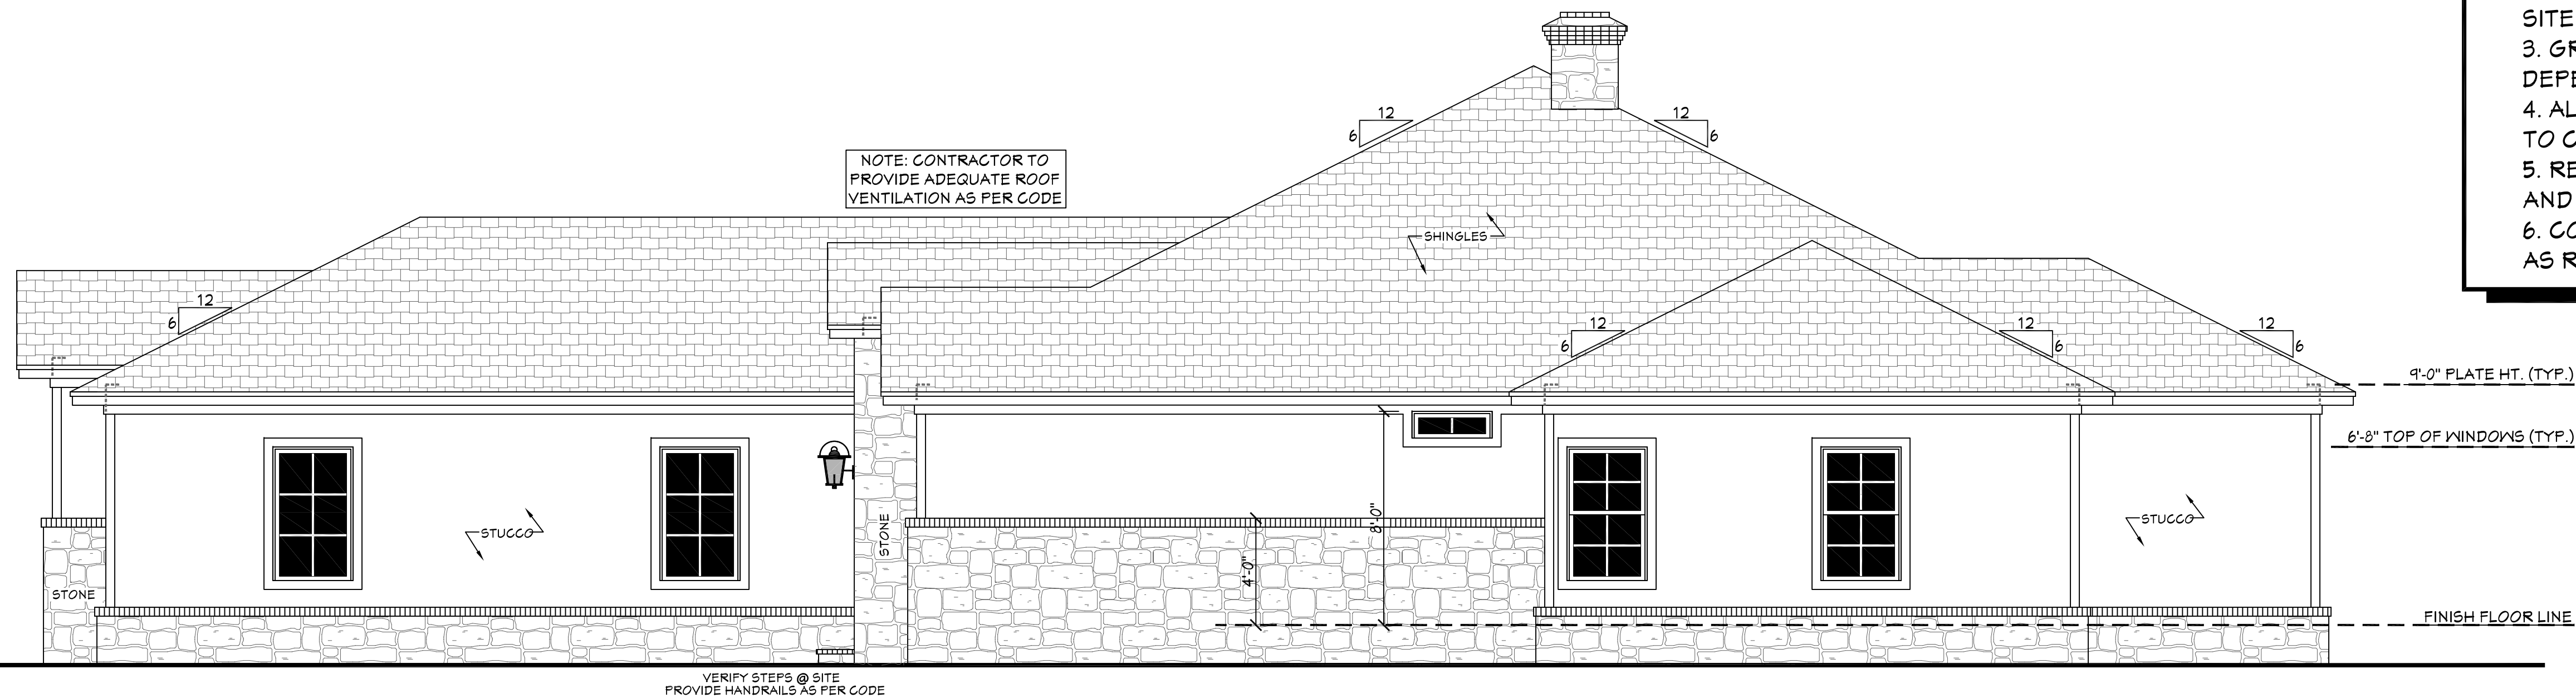

502 RIGHT VIEW
SCALE----- 1/4" = 1'-0"

3068 (DOOR LABEL ON FLOOR PLAN) IS A DOOR THAT IS 3 FT 0 INCHES WIDE BY 6 FEET 8 INCHES TALL. TO FURTHER CLARIFY, THE 3068 LABEL IS TO BE READ AS FEET AND INCHES (WIDTH) AND FEET AND INCHES (HEIGHT)

3050 (WINDOW LABEL ON FLOOR PLAN) IS A WINDOW THAT IS 3 FT 0 INCHES WIDE BY 5 FEET 0 INCHES TALL. TO FURTHER CLARIFY, THE 3050 LABEL IS TO BE READ AS FEET AND INCHES (WIDTH) AND FEET AND INCHES (HEIGHT)

THE DOOR LABEL IS THE ACTUAL SIZE OF THE DOOR ITSELF, NOT THE ROUGH OPENING SIZE. VERIFY THE ROUGH OPENING SIZE WITH THE WINDOW MANUFACTURER CHOSEN AT SITE.

THE WINDOW LABEL IS THE ACTUAL SIZE OF THE WINDOW ITSELF, NOT THE ROUGH OPENING SIZE. VERIFY THE ROUGH OPENING SIZE WITH THE WINDOW MANUFACTURER CHOSEN AT SITE.

DOOR SIZE

WINDOW SIZE

EGRESS

3068 DOOR: 3'-0" WIDE, 6'-8" TALL. FINISH FLOOR LINE AS SHOWN ON FLOOR PLAN.

3050 WINDOW: 3'-0" WIDE, 5'-0" TALL. WINDOW SIZE AS SHOWN ON FLOOR PLAN.

EGRESS: 20" MIN. NET CLEAR WIDTH. MIN. OF 5.7 SQUARE FEET GRADE OR BELOW GRADE SHALL HAVE A NET CLEAR OPENING OF NOT LESS THAN 5 SQUARE FEET. 24" MIN. SILL H.T. FOR SECONDARY FLOOR. 48" MAX. CLEAR H.T. SILLARY.

R311.1 Means of egress. Dwellings shall be provided with a means of egress in accordance with this section. The means of egress shall provide a continuous and unobstructed path of vertical and horizontal egress travel from all portions of the dwelling to the required egress door shall open directly into a public way or to a yard or court that opens to a public way.

R310.2.1 Minimum opening area. Emergency and escape rescue openings shall have a net clear opening of not less than 5.7 square feet (0.530 m²). The net clear opening dimensions required by this section shall be obtained by the normal operation of the emergency escape and rescue opening from the inside. The net clear height opening shall be not less than 24 inches (610 mm) and the net clear width shall be not less than 20 inches (508 mm). Exception: Grade floor or below grade openings shall have a net clear opening of not less than 5 square feet (0.465 m²).

R310.2.2 Window sill height. Where a window is provided as the emergency escape and rescue opening, it shall have a sill height of not more than 44 inches (1118 mm) above the floor; where the sill height is below grade, it shall be provided with a window well in accordance with Section R310.2.3.


R310.2.3 Window wells. The horizontal area of the window well shall be not less than 9 square feet (0.9 m²), with a horizontal projection and width of not less than 36 inches (914 mm). The area of the window well shall allow the emergency escape and rescue opening to be fully opened. Exception: The ladder or steps required by Section R310.2.3.1 shall be permitted to encroach not more than 6 inches (152 mm) into the required dimensions of the window well.

R310.2.3.1 Ladder and steps. Window wells with a vertical depth greater than 44 inches (1118 mm) shall be equipped with a permanently affixed ladder or steps usable with the window in the fully open position. Ladders or steps required by this section shall not be required to comply with Sections R311.1 and R311.8. Ladders or rungs shall have an inside width of not less than 12 inches (305 mm), shall project not less than 3 inches (76 mm) from the wall and shall be spaced not more than 18 inches (457 mm) on center vertically for the full height of the window well.

R312.2 Window fall protection. Window fall protection shall be provided in accordance with Sections R312.2.1 and R312.2.2.

R312.2.1 Window sills. In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610 mm) above the finished floor and greater than 12 inches (305 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:

1. Operable windows with openings that will not allow a 4-inch-diameter (102 mm) sphere to pass through the opening where the opening is in its largest opened position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F 2040.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.
4. Operable windows that are provided with window opening control devices that comply with ASTM F 2040. The window opening control device, after operation to release the control device allowing the window to fully open, shall not reduce the net clear opening area of the window unit to less than the area required by Section R310.2.1.

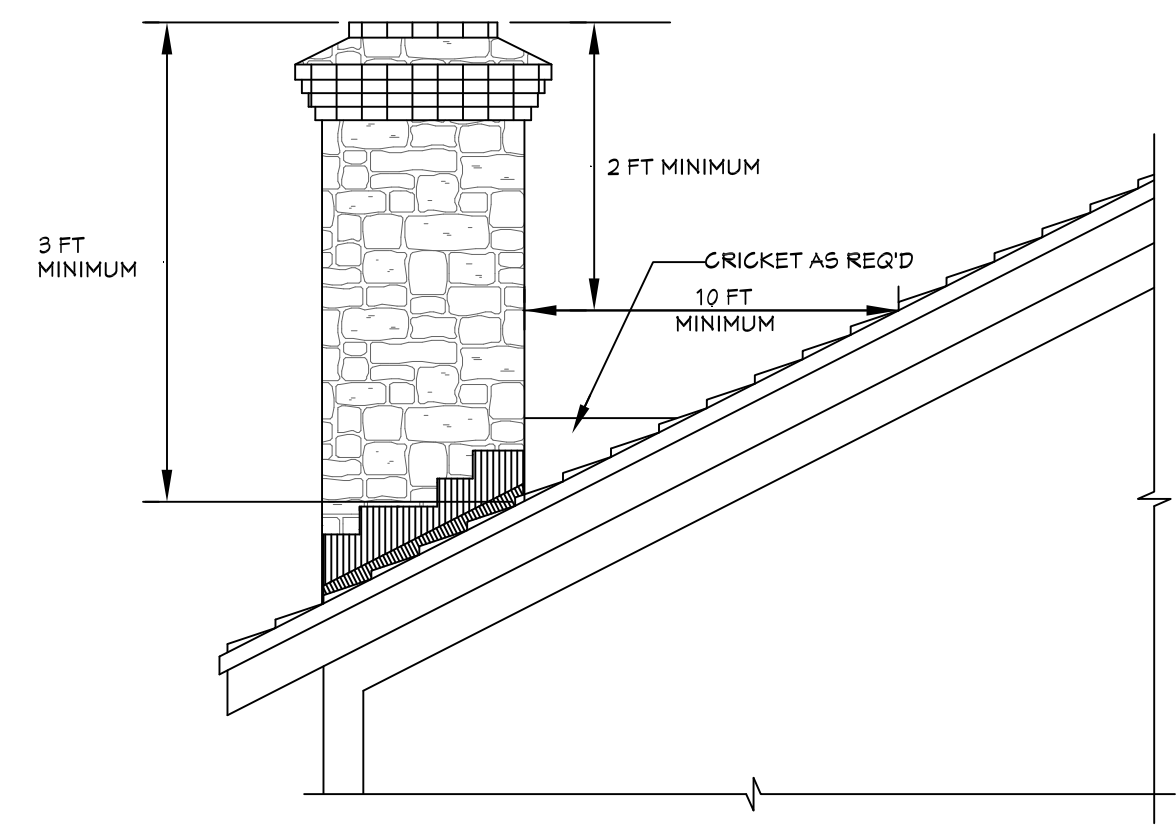


503 CHIMNEY BUILDING CODE DIMENSION REQUIREMENTS
SCALE----- N.T.S.

Website:
www.HPZplans.com

Email:
sales@hpzplans.com

Phone:
601.336.3254

Fax:
1.800.574.1387

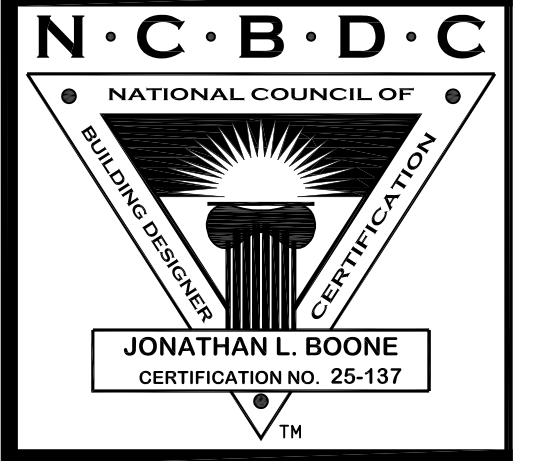

Pre-Drawn Plan ID:
BB-3044

Date:
12.05.18


Drawn By:
C.T.B.

SHEET NUMBER
5


House Plan Zone, LLC, has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes full responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

CROSS SECTION NOTES:


1. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AT SITE.
2. ALL RIDGE BEAMS, HIP RAFTERS, & VALLEY RAFTERS TO BE 2" x 10", OR AS REQ'D BY ENGINEER.
3. CONTRACTOR TO PROVIDE RAFTER BRACING TO MEET APPLICABLE CODES.
4. CONTRACTOR TO THOROUGHLY WATERPROOF ALL EXTERIOR INTERSECTIONS AS PER CODE AND TYPICAL BUILDING PRACTICES.
5. ALL BEAMS TO BE SIZED BY A LICENSED STRUCTURAL ENGINEER.
6. ALL LUMBER SIZES AND SPACING TO BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION.
7. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D. BY CURRENT CODES.

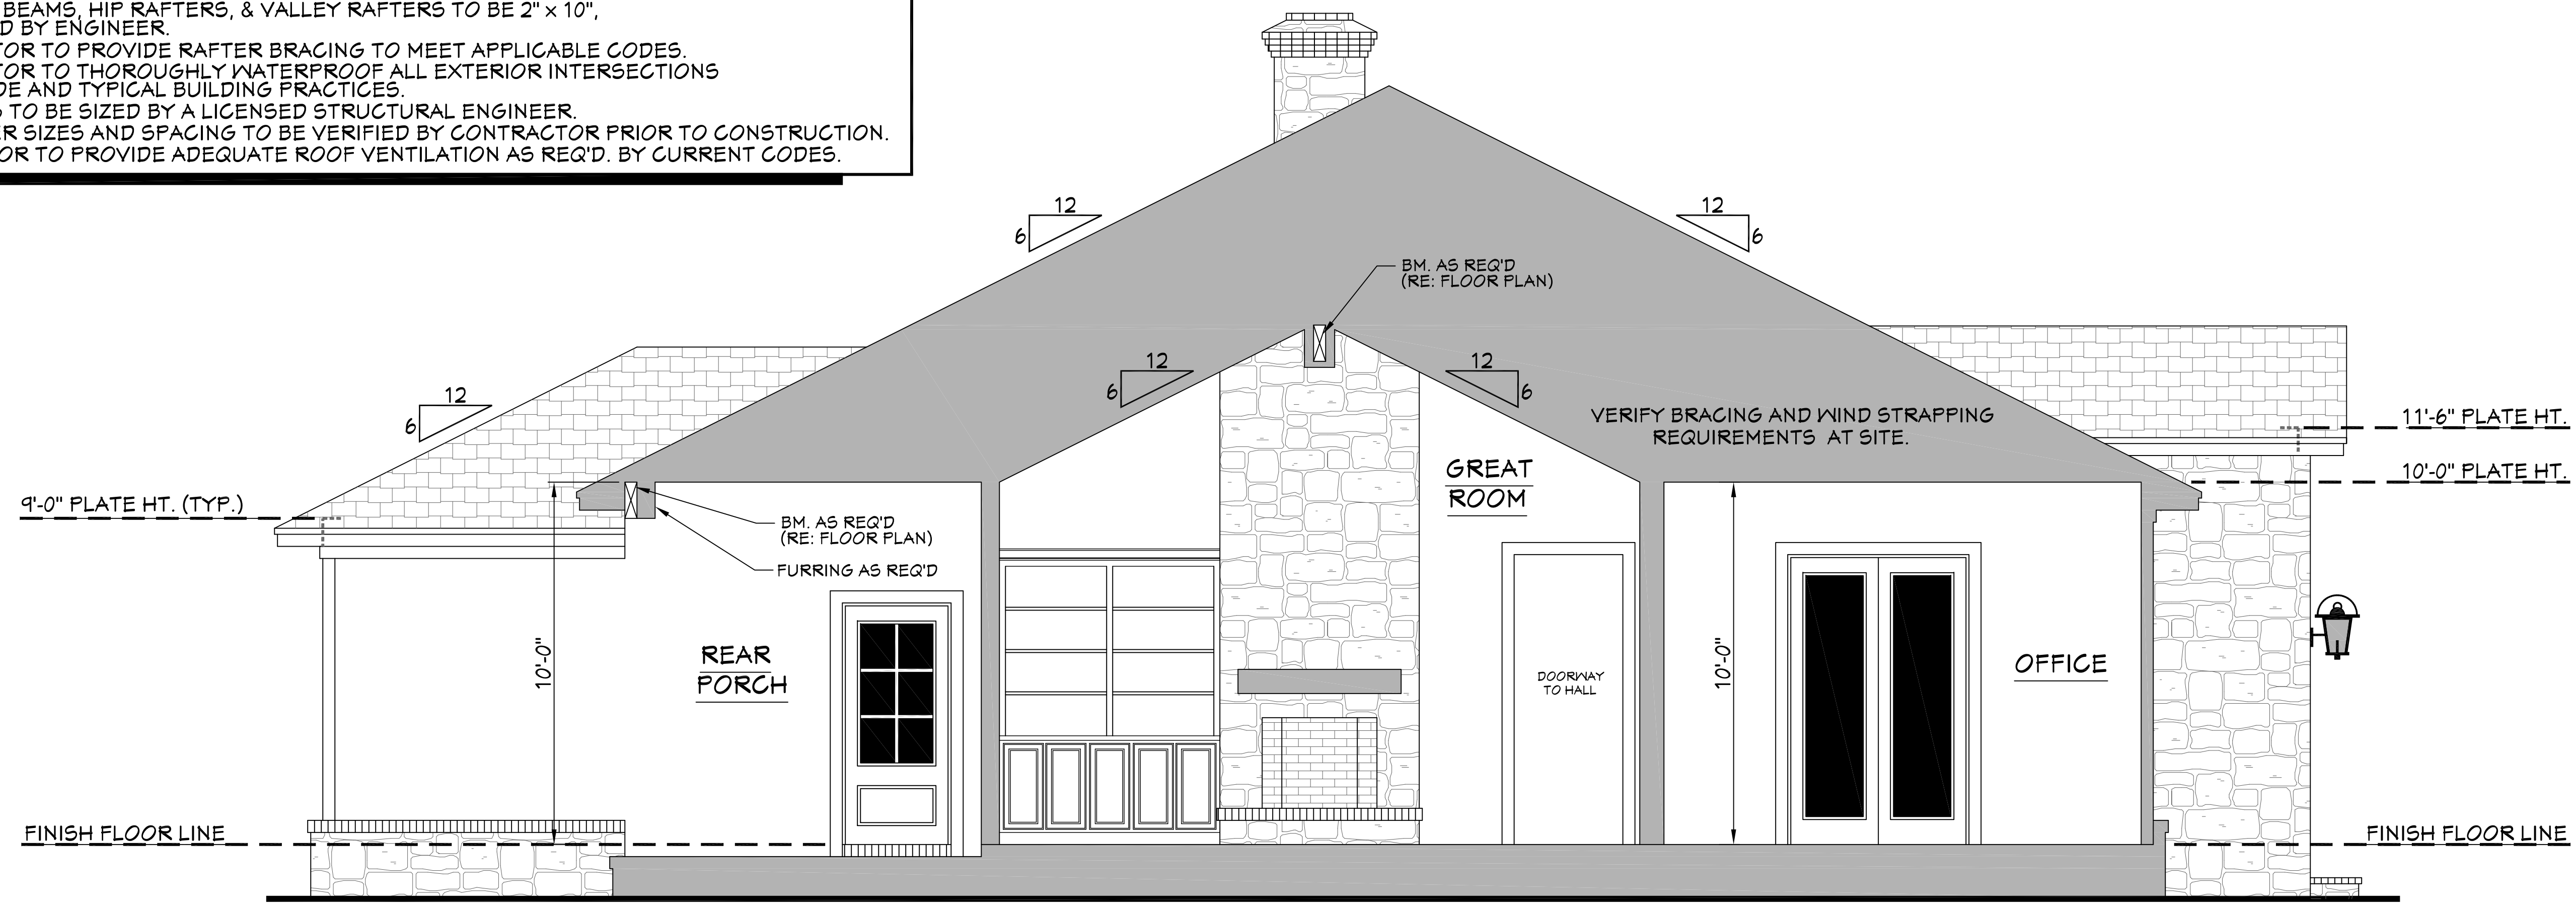


601 CROSS SECTION
SCALE-----3/8"=1'-0"

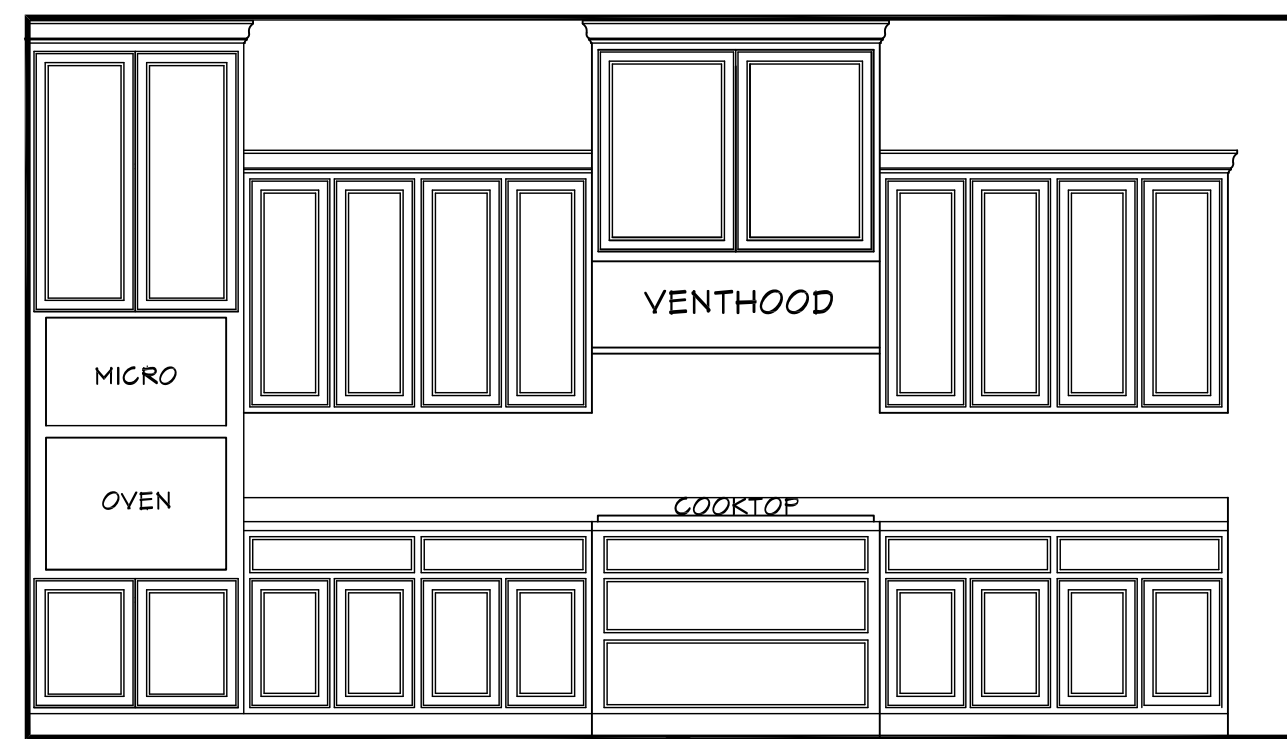


602 KITCHEN
SCALE-----3/8"=1'-0"

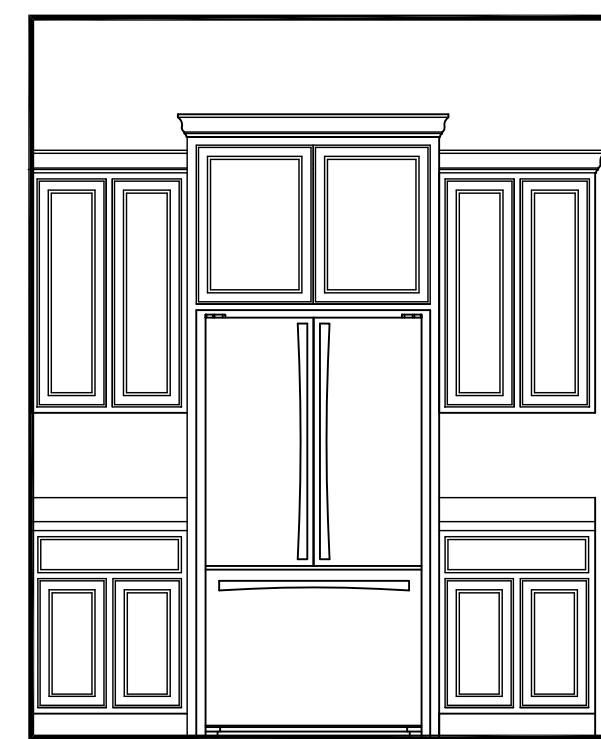


603 KITCHEN
SCALE-----3/8"=1'-0"

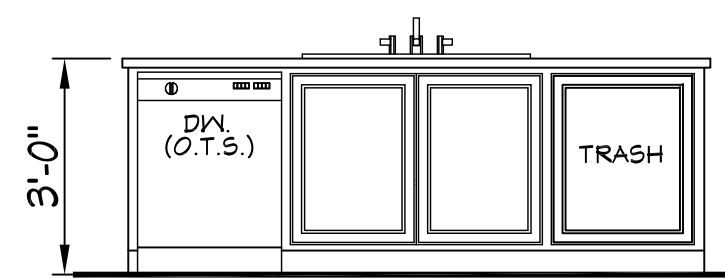

604 KITCHEN
SCALE-----3/8"=1'-0"

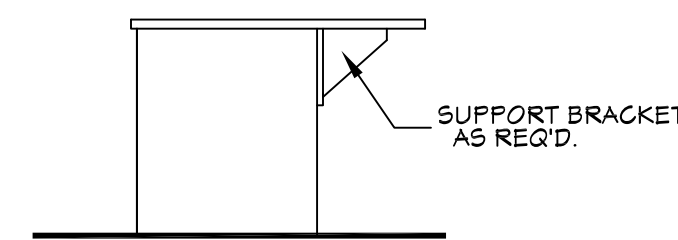


605 KITCHEN
SCALE-----3/8"=1'-0"

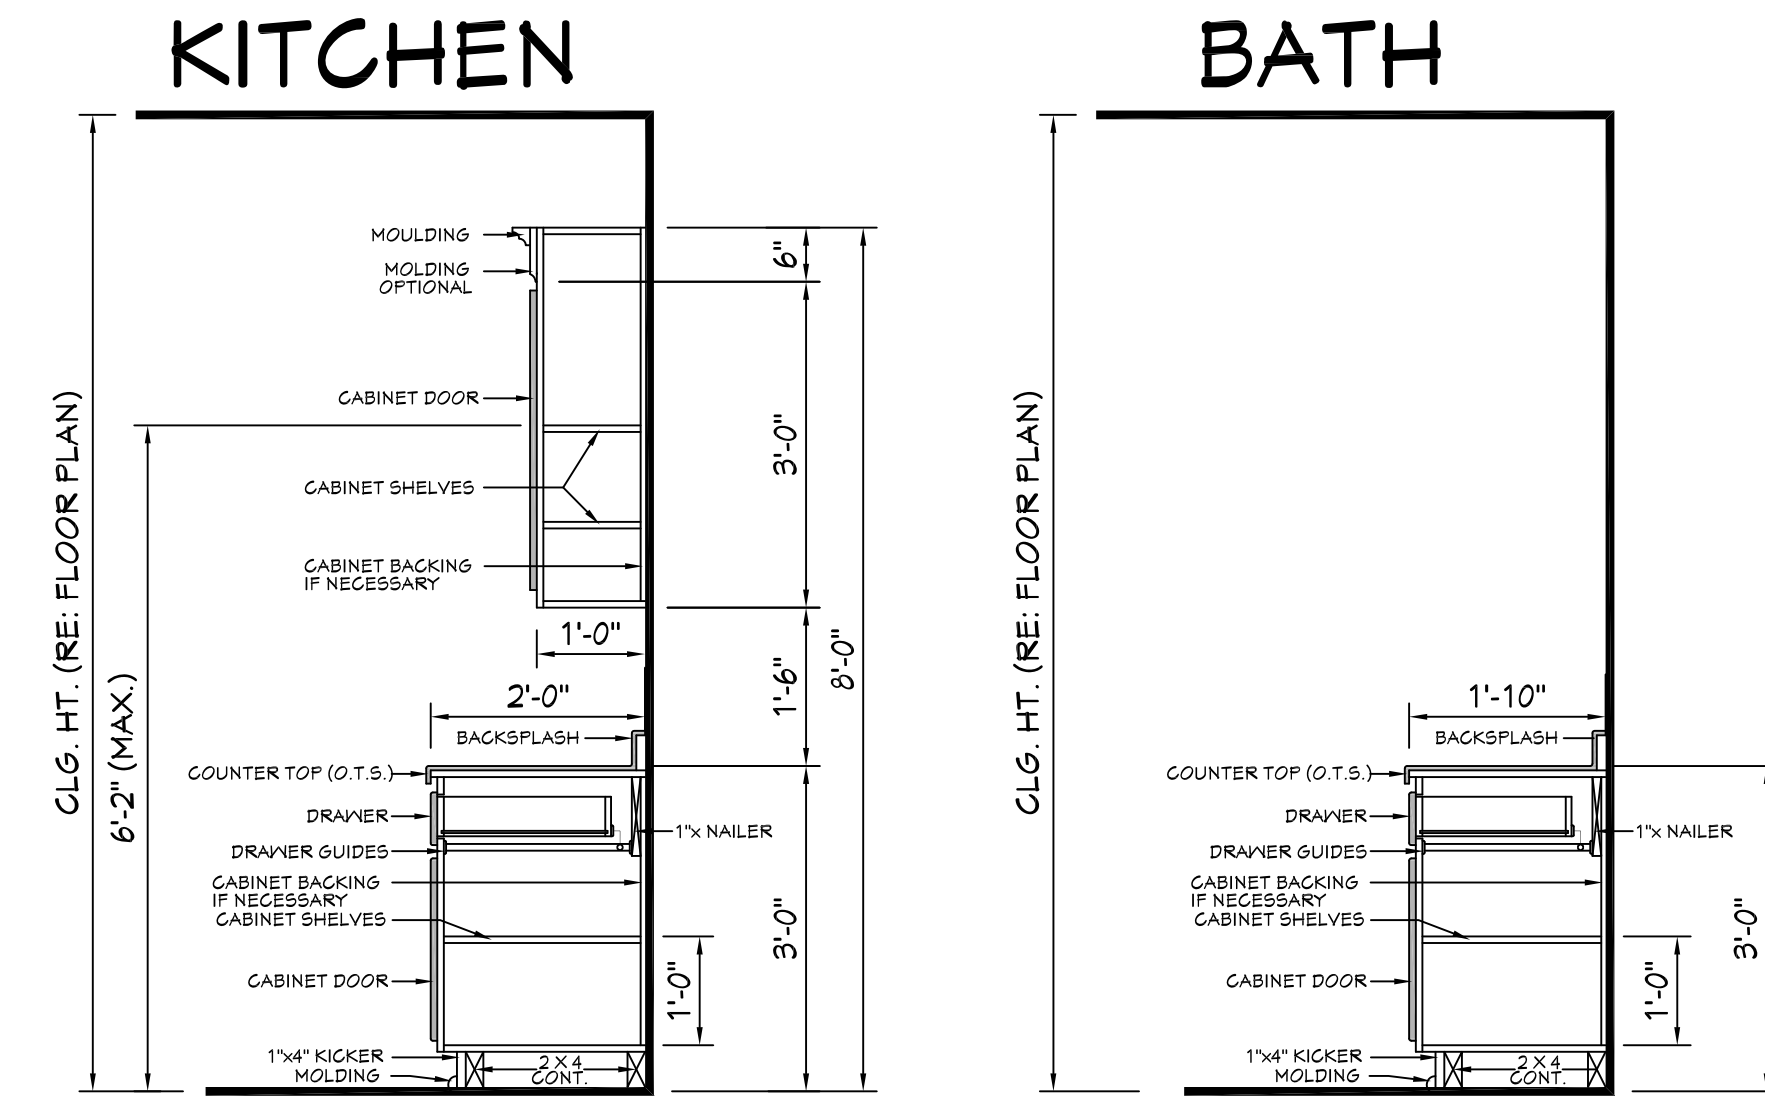

606 TYP. CAB. SECTIONS
SCALE-----N.T.S.

Designing Homes
HOUSE PLAN ZONE
Building Relationships

Website:
Email: sales@hpzplans.com
Phone: 601.336.3254
Fax: 1.800.574.1387

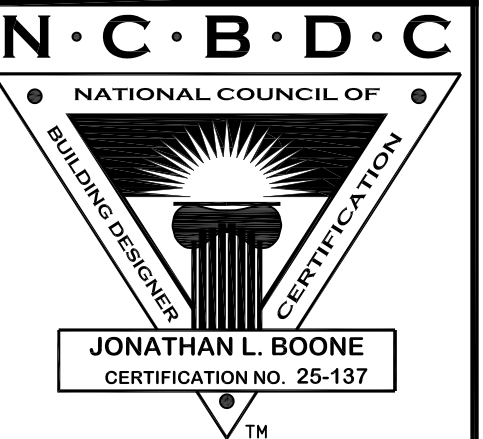


Pre-Drawn Plan ID:
BB-3044

Date: 12.05.18
Drawn By: J.A.B.


SHEET NUMBER
6

House Plan Zone, LLC, has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes full responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. House Plan Zone, LLC does not warrant the accuracy of these plans and is not responsible for any special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

701 ROOF PLAN
SCALE----- 1/4" = 1'-0"

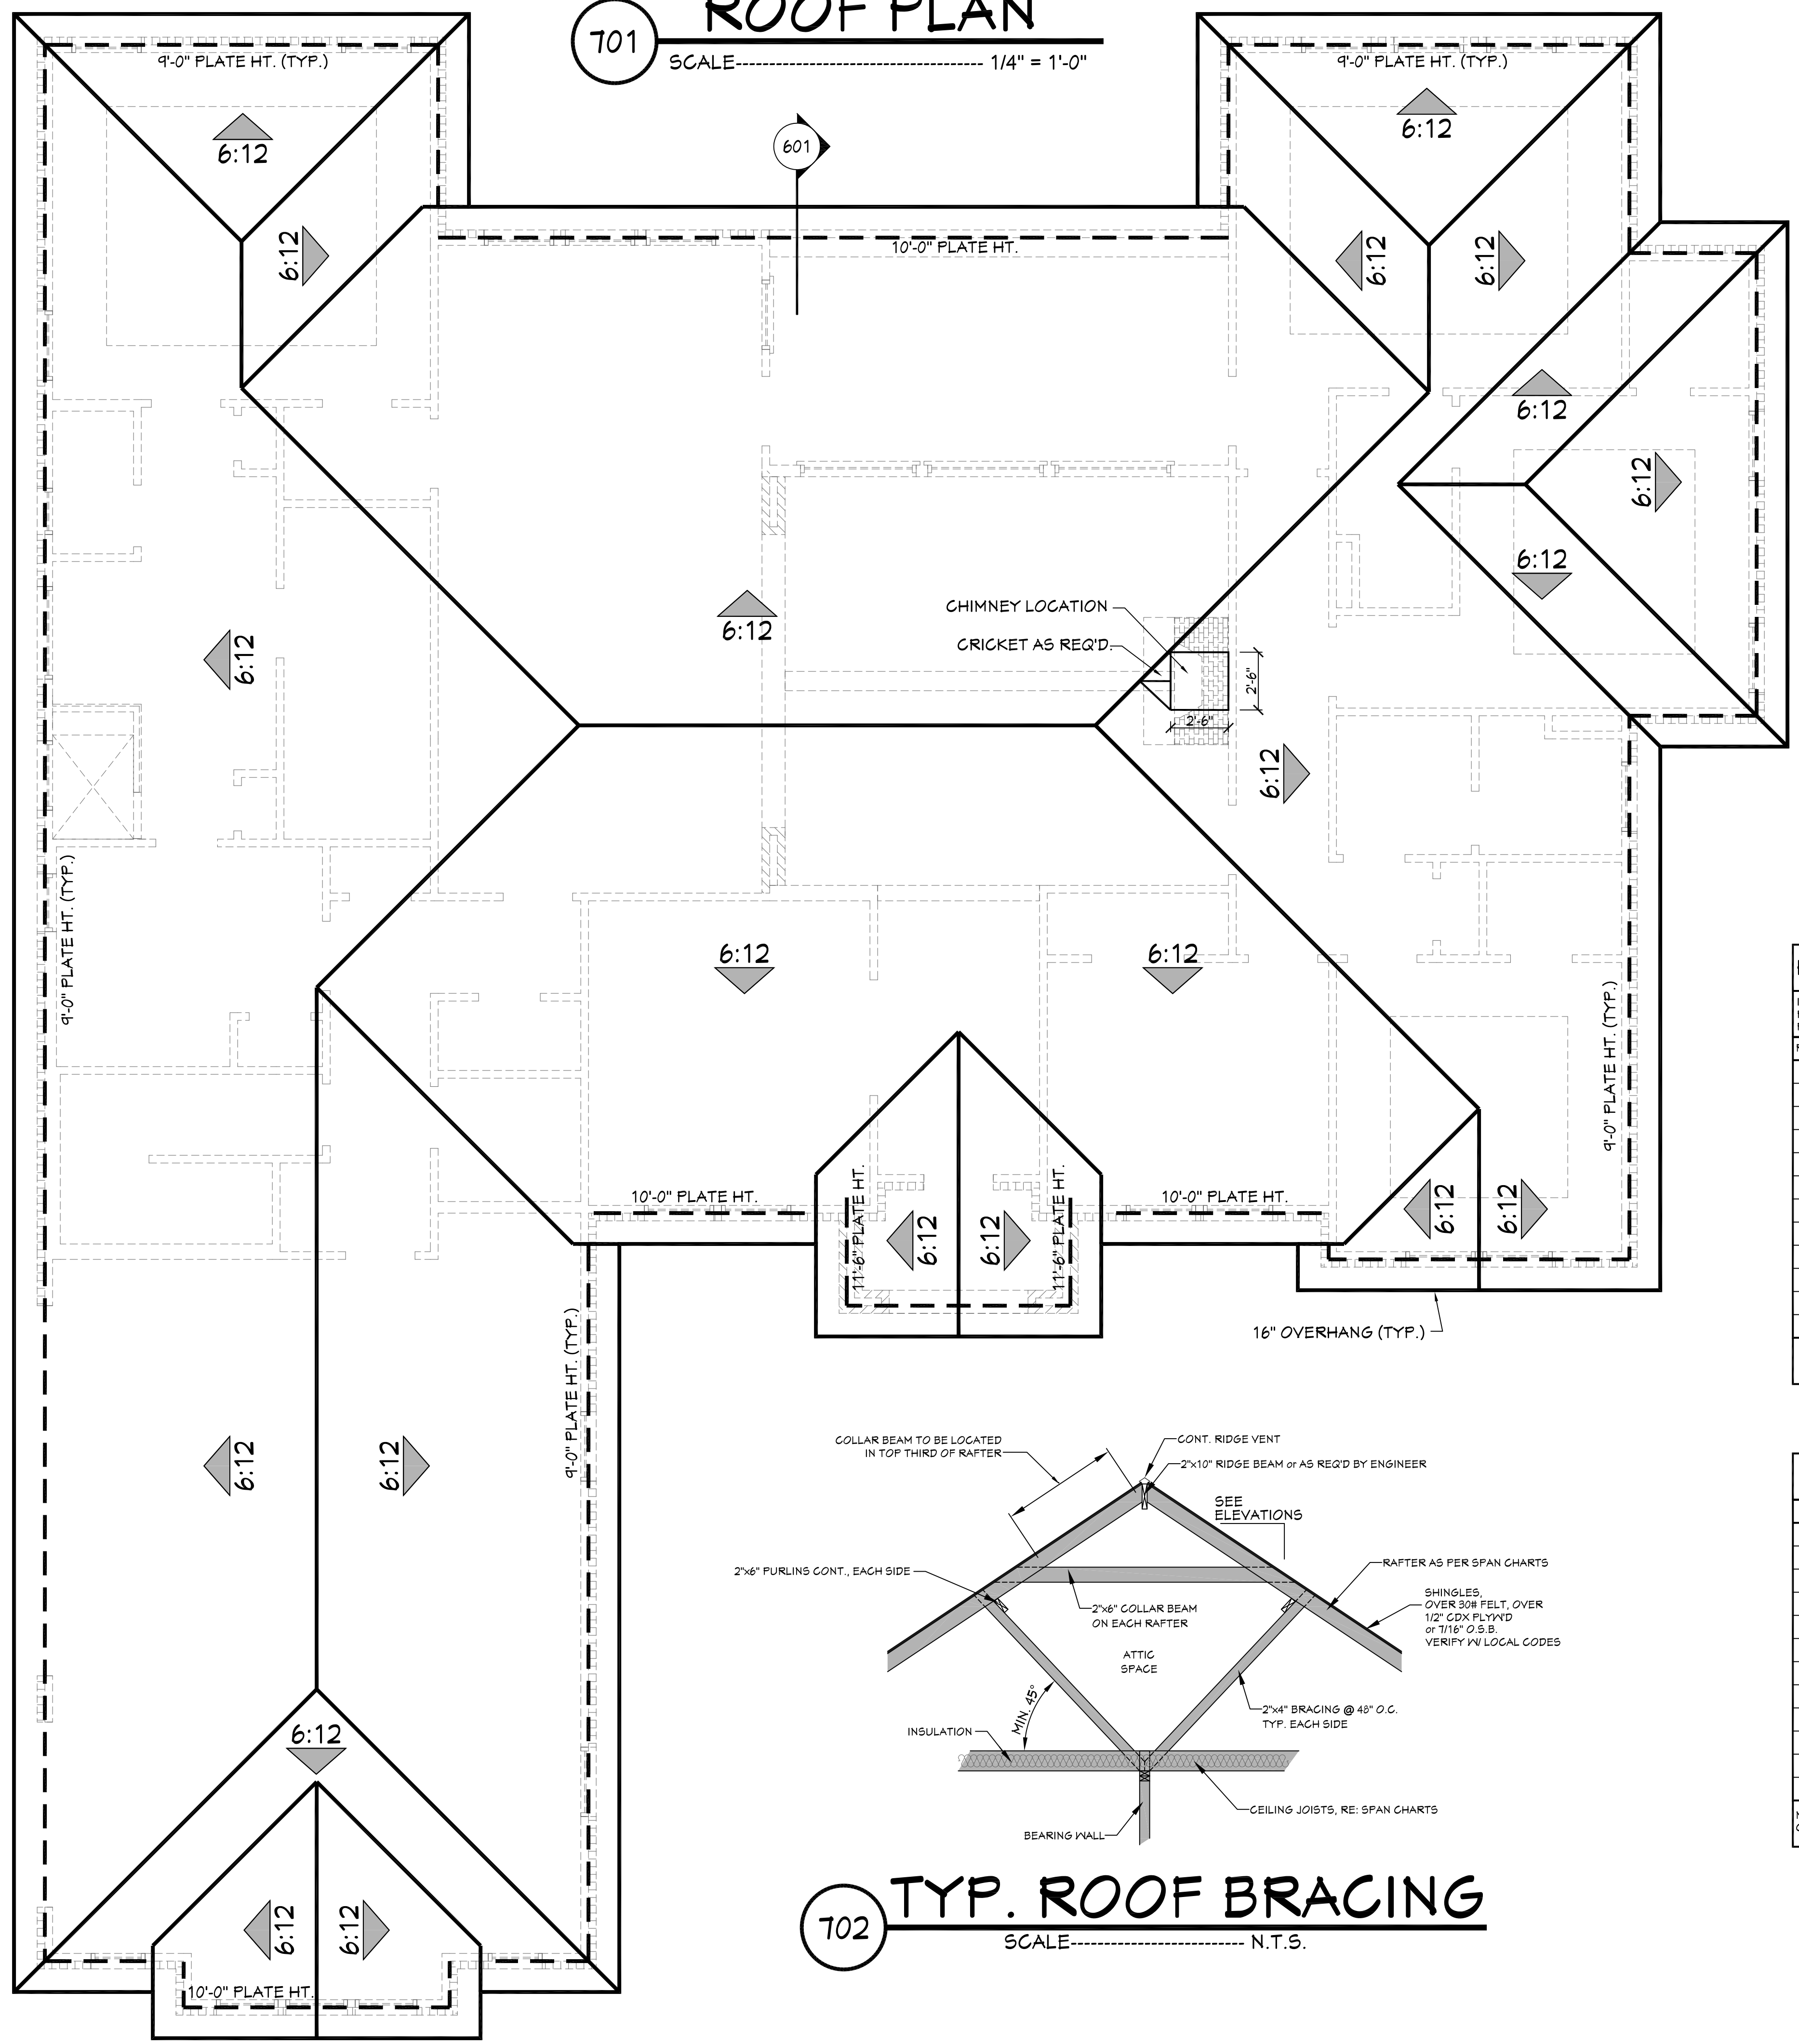

702 TYP. ROOF BRACING
SCALE----- N.T.S.

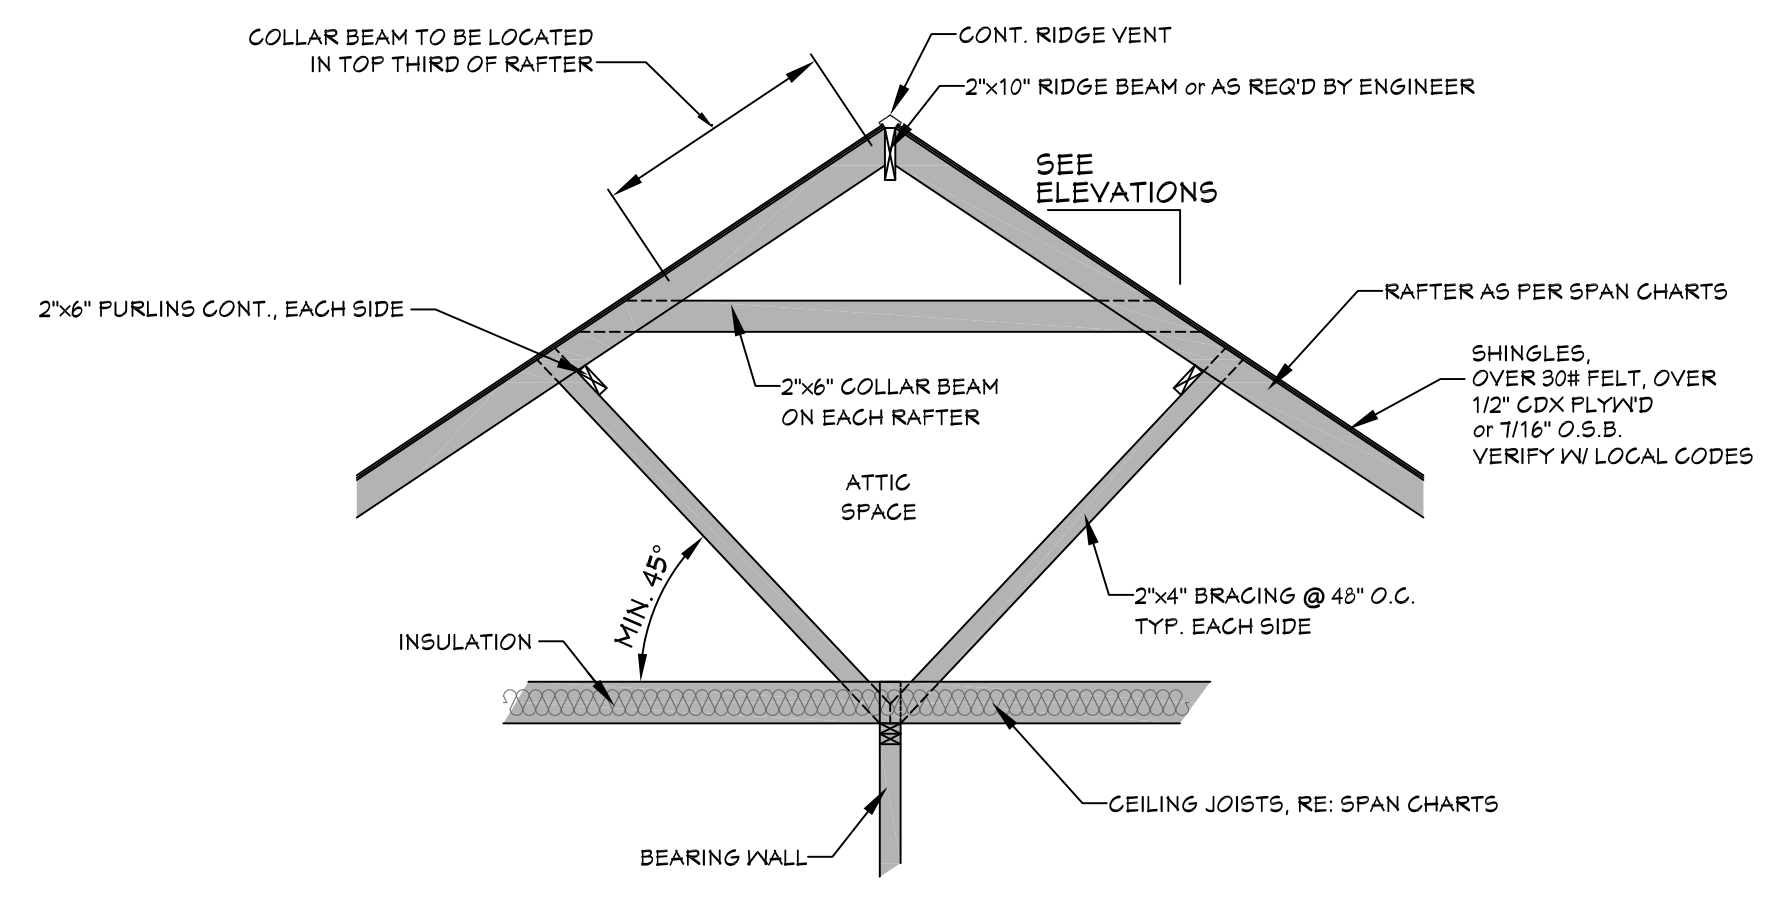

- ROOF PLAN NOTES:**
1. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AT SITE.
 2. ALL RIDGE BEAMS, HIP RAFTERS, & VALLEY RAFTERS TO BE 2" X 10", No.2 S.Y.P. OR AS REQ'D BY ENGINEER.
 3. ALL RAFTERS TO BE SIZED AS PER SPAN CHART.
 4. CONTRACTOR TO WATERPROOF ALL ROOF INTERSECTIONS AS PER CODE.
 5. CONTRACTOR TO VERIFY ALL ROOF PITCHES WITH EXTERIOR ELEVATIONS PRIOR TO CONSTRUCTION.
 6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.
 7. ALL ROOF PENETRATIONS TO BE ON SIDES OR REAR OF RESIDENCE. ALL PVC VENTS SHALL BE PAINTED BLACK OR TO MATCH ROOFING.

RAFTER SPANS
RAFTER SPANS FOR SOUTHERN PINE SPECIES
LIVE LOAD=30psf, L_{1Δ}=18' DEAD LOAD = 10psf

SIZE	SPACING (INCHES)	SPANS (MAXIMUM RAFTER SPANS BETWEEN BRACING) (FT. - IN.)
2 x 6	12.0	12-11
	16.0	11-2
	19.2	10-2
	24.0	9-2
2 x 8	12.0	16-4
	16.0	14-2
	19.2	12-11
	24.0	11-7
2 x 10	12.0	19-5
	16.0	16-10
	19.2	15-4
	24.0	13-9
2 x 12	12.0	22-10
	16.0	19-10
	19.2	18-1
	24.0	16-2

NOTES:
The above tables are based on the IRC 2015 TABLE R802.5.1(3)

HIP/VALLEY CONVERSION

IF COMMON RAFTER ROOF PITCHES:		THEN HIP/VALLEY RAFTER ROOF PITCH BECOMES:	
RISE/RUN	SLOPE	RISE/RUN	SLOPE
1/12	5°	1/11	3°
2/12	10°	2/11	7°
3/12	14°	3/11	10°
4/12	18°	4/11	13°
5/12	23°	5/11	16°
6/12	27°	6/11	19°
7/12	30°	7/11	22°
8/12	34°	8/11	25°
9/12	37°	9/11	28°
10/12	40°	10/11	30°
11/12	42°	11/11	33°
12/12	45°	12/11	35°

CONVERSION CHART FOR SIMPLE ROOFS ONLY. CHART DOES NOT APPLY FOR DUAL PITCH ROOFS.

CEILING JOIST SPANS
CEILING JOIST SPANS FOR SOUTHERN PINE SPECIES (UNINHABITABLE ATTICS WITH LIMITED STORAGE, LIVE LOAD = 20psf, L_{1Δ}=24' DEAD LOAD = 10psf)

IF HABITABLE ATTIC SPACE IS DESIRED, REFER TO THE INTERNATIONAL RESIDENTIAL CODE, SPAN TABLES.

SIZE	SPACING (INCHES)	VISUALLY GRADED #2 SOUTHERN PINE (MAXIMUM CEILING JOIST SPANS) (FT. - IN.)
2 x 4	12.0	9-3
	16.0	8-0
	19.2	7-4
	24.0	6-7
2 x 6	12.0	13-11
	16.0	12-0
	19.2	11-0
	24.0	9-10
2 x 8	12.0	17-7
	16.0	15-3
	19.2	13-11
	24.0	12-6
2 x 10	12.0	20-11
	16.0	18-1
	19.2	16-6
	24.0	14-4


NOTES:
The above tables are based on the IRC 2015 TABLE R802.4(2)

RAFTER LENGTH CHART

ROOF PITCH	FACTOR
3/12	1.05
4/12	1.07
5/12	1.10
6/12	1.14
7/12	1.17
8/12	1.20
9/12	1.25
10/12	1.30
11/12	1.35
12/12	1.40
14/12	1.54
16/12	1.70

MULTIPLY HORIZONTAL SPAN OF MEMBER BY FACTOR. CHOOSE APPROPRIATE FACTOR BY ROOF PITCH.


Website:
www.HFZplans.com
Email:
sales@hpfzplans.com
Phone:
601.336.3254
Fax:
1.800.574.1387

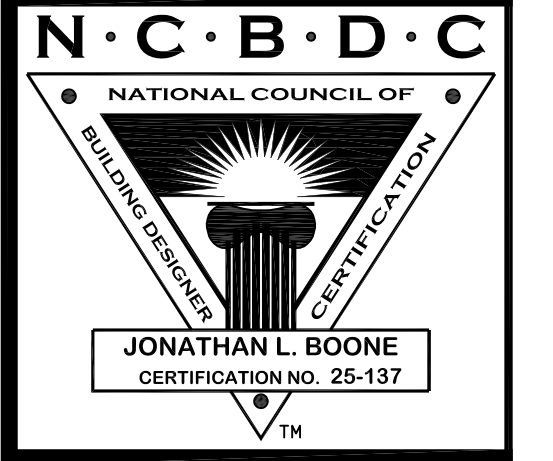

Pre-Drawn Plan ID:
BB-3044

House Plan Zone, LLC, has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes full responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions may be required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

Date:
12.05.18
Drawn By:
C.T.B.

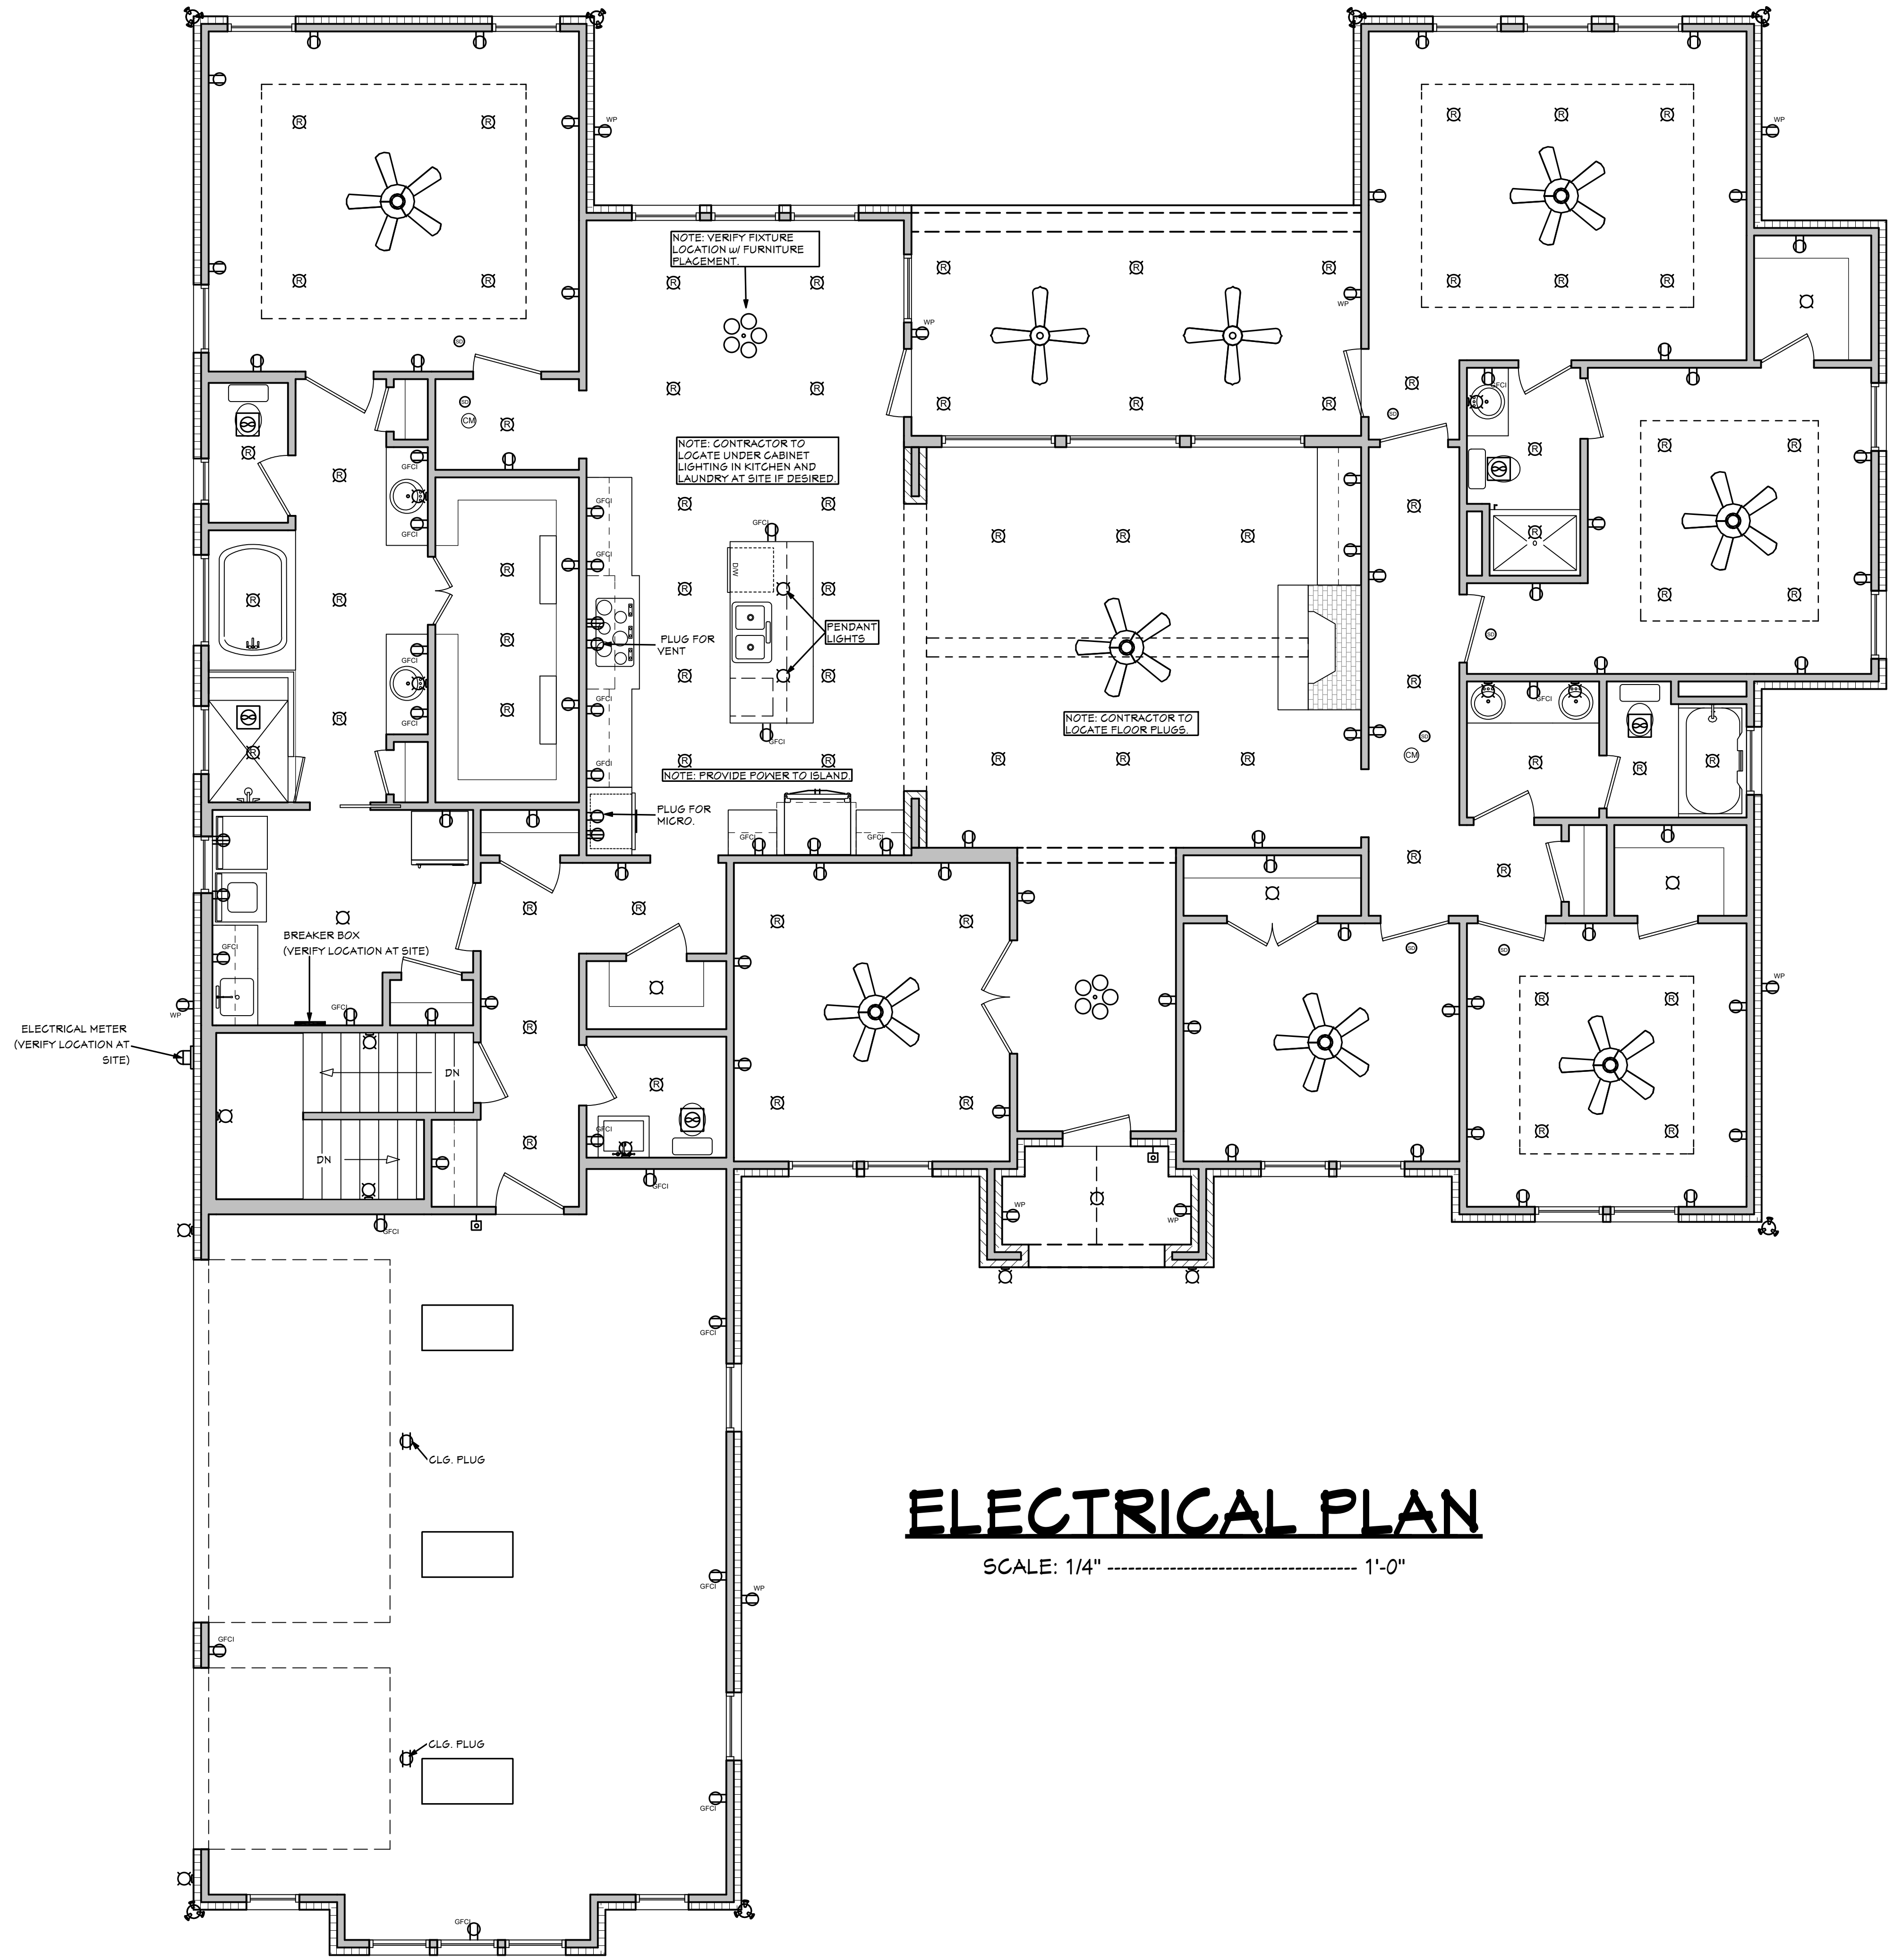

ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

ELECTRICAL SYMBOLS LEGEND			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	110 VOLT OUTLET		TV SPEAKER
	GROUND FAULT PROTECTED OUTLET		RADIO SPEAKER
	WEATHERPROOF OUTLET		CEILING FAN ONLY, NO LIGHT KIT
	220 VOLT RECEPTACLE		CEILING FAN WITH LIGHT KIT
	FLOOR OUTLET (OWNER TO LOCATE)		TRACK LIGHTING (OWNER TO LOCATE)
	CEILING HUNG FIXTURE		WALL SCONCE (OWNER TO LOCATE)
	OVERHANG MOUNTED FLOODLIGHTS		CHANDELIER 1 (O.T.S.)
	WALL MOUNTED FLOODLIGHTS		CHANDELIER 2 (O.T.S.)
	RECESSED CEILING FIXTURE		UNDER COUNTER LIGHTING
	FLUORESCENT LIGHT		EMERGENCY LIGHTING/ EXIT SIGN
	CARBON MONOXIDE DETECTOR		
	SMOKE DETECTOR		
	SWITCH		
	THREE WAY SWITCH		
	WALL MOUNTED LIGHT		
	DIMMER SWITCH (OWNER TO LOCATE)		
	DOOR ACTIVATED SWITCH		
	WEATHERPROOF OUTLET		
	CAT5 NETWORKING JACK (OWNER TO LOCATE)		
	TELEPHONE OUTLET (OWNER TO LOCATE)		
	TELEVISION OUTLET (OWNER TO LOCATE)		
	DOORBELL BUTTON (CONTRACTOR TO LOCATE)		
	THERMOSTAT (CONTRACTOR TO LOCATE)		
	CEILING EXHAUST FAN, VENT TO EXTERIOR		

ELECTRICAL NOTES:
 1. ALL WORK SHALL COMPLY WITH ALL CODES APPLICABLE AT SITE.
 2. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS: EACH SLEEPING ROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS, ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS. WHEN MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN A DWELLING THE ALARM DEVICES SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTIVATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE UNIT. SMOKE ALARMS SHALL BE HARD WIRED WITH A BATTERY BACK UP.
 3. CARBON MONOXIDE ALARMS SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS WITH ATTACHED GARAGES.
 4. A 125 VOLT, SINGLE PHASE, 15-20 AMPERE RATED RECEPTACLE OUTLET SHALL BE INSTALLED AT AN ACCESSIBLE LOCATION FOR THE SERVICING OF HEATING, AIR CONDITIONING AND REFRIGERATION EQUIPMENT. THE RECEPTACLE SHALL BE LOCATED ON THE SAME LEVEL AND WITHIN 25 FEET OF THE EQUIPMENT. THE RECEPTACLE OUTLET SHALL NOT BE CONNECTED TO THE LOAD SIDE OF THE HVAC EQUIPMENT DISCONNECTING MEANS.

House Plan Zone, LLC has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user of these plans shall be responsible for any errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction, and other special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.